

Technical Information

Micropilot FMR20

Free space radar

Level measurement for liquids



Application

- Ingress protection: IP66/68 / NEMA 4X/6P
- Measuring range: up to 20 m (66 ft)
- Process temperature: -40 to 80 °C (-40 to 176 °F)
- Process pressure: -1 to 3 bar (-14 to 43 psi)
- Accuracy: up to +/- 2 mm (0.08 in)
- International explosion protection certificates

Your benefits









- Level measurement for liquids in storage tanks, open basins, pump shafts and canal systems
- Radar measuring device with *Bluetooth*® wireless technology and HART communication
- Simple, safe and secure wireless remote access – ideal for installation in hazardous areas or places difficult to reach
- Commissioning, operation and maintenance via free iOS / Android app SmartBlue – saves time and reduces costs
- Full PVDF body – for a long sensor lifetime
- Hermetically sealed wiring and fully potted electronics – eliminates water ingress and allows operation under harsh environmental conditions
- Most compact radar due to unique radar chip design – fits in limited space installations
- Best price-performance-ratio radar

Table of contents





| | | | |
|--|-----------|---|-----------|
| Document information | 3 | Environment | 23 |
| Symbols for certain types of information | 3 | Ambient temperature range | 23 |
| Safety symbols | 3 | Storage temperature | 23 |
| Symbols in graphics | 3 | Climate class | 23 |
| Terms and abbreviations | 3 | Installation height as per IEC 61010-1 Ed.3 | 23 |
| Registered trademarks | 4 | Degree of protection | 23 |
| Product life cycle | 5 | Vibration resistance | 23 |
| Engineering | 5 | Cleaning the antenna | 23 |
| Procurement | 5 | Electromagnetic compatibility (EMC) | 23 |
| Installation | 5 | Process | 24 |
| Commissioning | 5 | Process temperature, process pressure | 24 |
| Operation | 5 | Dielectric constant | 24 |
| Maintenance | 5 | Mechanical construction | 25 |
| Retirement | 5 | Dimensions | 25 |
| Measuring principle | 5 | Weight | 31 |
| Input | 6 | Housing/process connection materials | 31 |
| Output | 6 | Connecting cable | 32 |
| Input | 6 | Counter nut G 1 | 32 |
| Measured variable | 6 | Operability | 33 |
| Measuring range | 6 | Operating concept | 33 |
| Operating frequency | 7 | Via Bluetooth® wireless technology | 33 |
| Transmission power | 7 | Via HART protocol | 33 |
| Output | 8 | Certificates and approvals | 34 |
| Output signal | 8 | CE mark | 34 |
| Digital output | 8 | RoHS | 34 |
| Signal on alarm | 8 | RCM-Tick marking | 34 |
| Linearization | 8 | Ex-Zulassung | 34 |
| Protocol-specific data | 8 | Explosion-protected smartphones and tablets | 34 |
| Electrical connection | 9 | Pressure Equipment Directive | 34 |
| Cable assignment | 9 | Radio standard EN 302729-1/2 | 34 |
| Supply voltage | 9 | FCC / Industry Canada | 35 |
| Connection | 10 | Other standards and guidelines | 36 |
| Power consumption | 12 | Ordering information | 36 |
| Current consumption | 12 | Accessories | 37 |
| Start-up time | 12 | Device-specific accessories | 37 |
| Power supply failure | 12 | Communication-specific accessories | 49 |
| Cable specification | 12 | Service-specific accessories | 50 |
| Overvoltage protection | 13 | System components | 50 |
| Performance characteristics | 14 | Supplementary documentation | 51 |
| Reference operating conditions | 14 | Standard documentation | 51 |
| Maximum measured error | 14 | Supplementary documentation | 51 |
| Measured value resolution | 14 | Safety Instructions (XA) | 51 |
| Response time | 15 | Installation | 16 |
| Influence of ambient temperature | 15 | Installation conditions | 16 |

Document information




Symbols for certain types of information

| Symbol | Meaning |
|---|--|
|  | Permitted Procedures, processes or actions that are permitted. |
|  | Preferred Procedures, processes or actions that are preferred. |
|  | Forbidden Procedures, processes or actions that are forbidden. |
|  | Tip Indicates additional information. |
|  | Reference to documentation |
|  | Reference to page |
|  | Reference to graphic |
|  | Visual inspection |

Safety symbols

| Symbol | Meaning |
|---|--|
|  | DANGER! This symbol alerts you to a dangerous situation. Failure to avoid this situation will result in serious or fatal injury. |
|  | WARNING! This symbol alerts you to a dangerous situation. Failure to avoid this situation can result in serious or fatal injury. |
|  | CAUTION! This symbol alerts you to a dangerous situation. Failure to avoid this situation can result in minor or medium injury. |
|  | NOTE! This symbol contains information on procedures and other facts which do not result in personal injury. |

Symbols in graphics

| Symbol | Meaning |
|---|--|
| 1, 2, 3 ... | Item numbers |
|  | Series of steps |
| A, B, C, ... | Views |
| A-A, B-B, C-C, ... | Sections |
|  | Hazardous area Indicates a hazardous area. |
|  | Safe area (non-hazardous area) Indicates the non-hazardous area. |

Terms and abbreviations

| Term/abbreviation | Explanation |
|-------------------|--|
| BA | Document type "Operating Instructions" |
| KA | Document type "Brief Operating Instructions" |
| TI | Technical Information |

| Term/abbreviation | Explanation |
|-------------------|---|
| SD | Document type "Special Documentation" |
| XA | Document type "Safety Instructions" |
| PN | Nominal pressure |
| MWP | Maximum Working Pressure The MWP can also be found on the nameplate. |
| ToF | Time of Flight |
| FieldCare | Scalable software tool for device configuration and integrated plant asset management solutions |
| DeviceCare | Universal configuration software for Endress+Hauser HART, PROFIBUS, FOUNDATION Fieldbus and Ethernet field devices |
| DTM | Device Type Manager |
| DD | Device Description for HART communication protocol |
| DK | Relative dielectric constant ϵ_r |
| Operating tool | The term "operating tool" is used in place of the following operating software: <ul style="list-style-type: none"> ▪ SmartBlue (app), for operation using an Android or iOS smartphone or tablet. ▪ FieldCare / DeviceCare, for operation via HART communication and PC |
| BD | Blocking Distance; no signals are analyzed within the BD. |

Registered trademarks



Registered trademark of the FieldComm Group, Austin, USA



The *Bluetooth*® word mark and logos are registered trademarks owned by the Bluetooth SIG, Inc. and any use of such marks by Endress+Hauser is under license. Other trademarks and trade names are those of their respective owners."


Apple®

Apple, the Apple logo, iPhone, and iPod touch are trademarks of Apple Inc., registered in the U.S. and other countries. App Store is a service mark of Apple Inc.

Android®


Android, Google Play and the Google Play logo are trademarks of Google Inc.

Product life cycle

| | |
|----------------------|---|
| Engineering | <ul style="list-style-type: none"> ▪ Proven radar measuring technology ▪ Level- and open channel flow measurement for Ex and non-Ex ▪ Indication of over-flooding situation ▪ Wide range of installation possibilities and accessories ▪ Highest degree of ingress protection ▪ 2D / 3D drawings ▪ Spec Sheet Producer ▪ Applicator Selection tool for the selection of the perfect measurement solution <p> Device not compatible with transmitters and sensors of ultrasonic measurement technology (e.g. Prosonic FMU9x, FDU9x)</p> |
| Procurement | <ul style="list-style-type: none"> ▪ Best price-performance-ratio radar ▪ Global availability ▪ Order code includes variety of mounting accessories and remote HART indicator RIA15 |
| Installation | <ul style="list-style-type: none"> ▪ Rear- and front side thread for flexible installation ▪ Slip- on flange for nozzle installation ▪ Complete measuring point: Including mounting accessory, RIA15 and flooding protection tube |
| Commissioning | <ul style="list-style-type: none"> ▪ Easy and fast setup via SmartBlue (app) and DeviceCare / FieldCare or RIA15 ▪ No additional tools or adapters required ▪ Local languages (up to 15) |
| Operation | <ul style="list-style-type: none"> ▪ Continuous self-monitoring ▪ Diagnosis information acc. NAMUR NE107 with clear text messages remedy directives ▪ Signal curve via SmartBlue (app) and DeviceCare / FieldCare ▪ Encrypted single point-to-point data transmission (Fraunhofer-Institut, third party, tested) and password-protected communication via <i>Bluetooth</i>[®] wireless technology |
| Maintenance | <ul style="list-style-type: none"> ▪ No maintenance required ▪ Technical experts on-call around the global |
| Retirement | <ul style="list-style-type: none"> ▪ Environmentally responsible recycling concepts ▪ RoHS compliance (Restriction of certain hazardous substances), lead-free soldering of electronic components |

Measuring principle

The Micropilot is a "downward-looking" measuring system, operating based on the time-of-flight method (ToF). It measures the distance from the reference point (process connection) to the product surface. Radar impulses are emitted by an antenna, reflected off the product surface and received again by the radar system.

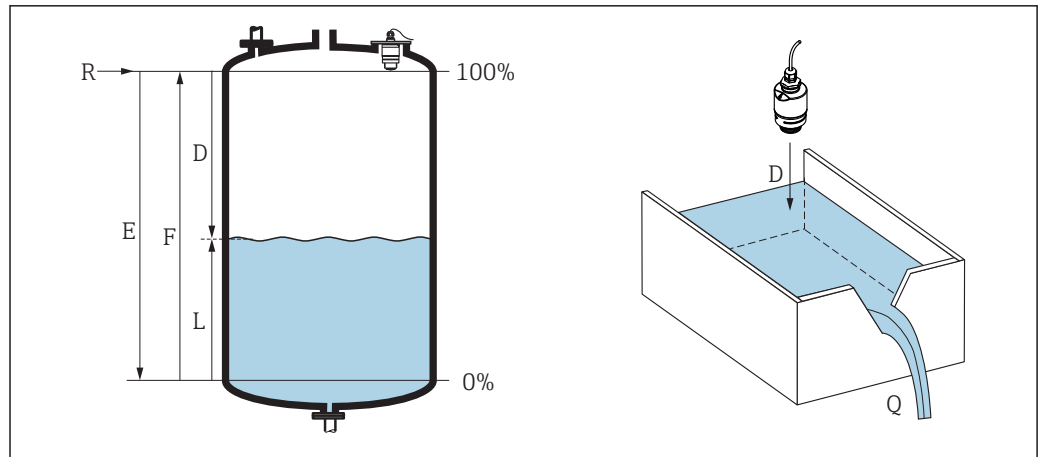

A002B409

1 Setup parameters of the Micropilot

E Empty calibration (= zero)

F Full calibration (= span)

D Measured distance

L Level ($L = E - D$)

Q Flow rate at measuring weirs or channels (calculated from the level using linearization)

Input

The reflected radar impulses are received by the antenna and transmitted into the electronics. A microprocessor evaluates the signal and identifies the level echo caused by the reflection of the radar impulse at the product surface. This clear signal detection system benefits from over 30 years' experience with time-of-flight procedures.

The distance **D** to the product surface is proportional to the time of flight **t** of the impulse:

$$D = c \cdot t / 2,$$

where **c** is the speed of light.

Based on the known empty distance **E**, the level **L** is calculated:

$$L = E - D$$

Output

The Micropilot is adjusted by entering the empty distance **E** (= zero point) and the full distance **F** (= span).

- Current output: 4 to 20 mA
- Digital output (HART, SmartBlue): 0 to 10 m (0 to 33 ft) or 0 to 20 m (0 to 66 ft) depending on antenna version

Input

Measured variable

The measured variable is the distance between the reference point and the product surface.

The level is calculated based on **E**, the empty distance entered.

Measuring range

Maximum measuring range

| Device | Maximum measuring range |
|-------------------------------------|-------------------------|
| FMR20 - with 40 mm (1.5 in) antenna | 10 m (33 ft) |
| FMR20 - with 80 mm (3 in) antenna | 20 m (66 ft) |

Requirements of the installation

- recommended tank height greater than 1.5 m (5 ft) in case of media with low DK value
- Open channel minimum width 0.5 m (1.6 ft)
- Calm surfaces
- No agitators
- No buildup
- Relative dielectric constant $\epsilon_r > 4$

Usable measuring range

The usable measuring range depends on the antenna size, the medium's reflective properties, the installation position and any possible interference reflections.

The following table describes the media groups.

Media groups

| ϵ_r | Example |
|--------------|---|
| 4 to 10 | E.g. concentrated acid, organic solvents, ester, aniline, alcohol, acetone. |
| > 10 | Conductive liquids, aqueous solutions, diluted acids and bases |

Reduction of the max. possible measuring range by:

- Media with bad reflective properties (= low ϵ_r value)
- Formation of buildup, particularly of moist products
- Strong condensation
- Foam generation
- Freezing of sensor

Operating frequency K-band (~ 26 GHz)

| Transmission power | Distance | Mean power density in the direction of the beam |
|--------------------|--------------|---|
| | 1 m (3.3 ft) | < 12 nW/cm ² |
| | 5 m (16 ft) | < 0.4 nW/cm ² |

Output

Output signal

4 to 20 mA

A 4 to 20 mA interface serves as measured value output and to power the device.

Digital output

HART®

- Signal encoding; FSK ± 0.5 mA over current signal
- Data transmission rate; 1 200 Bit/s

Bluetooth® wireless technology (can be ordered as an option)

The device has a *Bluetooth®* wireless technology interface and can be operated and configured via this interface using the SmartBlue app.

- The range under reference conditions is at least 10 m (33 ft)
- Incorrect operation by unauthorized persons is prevented by means of encrypted communication and password encryption.
- The *Bluetooth®* wireless technology interface can be deactivated

Signal on alarm

Depending on the interface, failure information is displayed as follows:

- Current output
Alarm current: 22.5 mA
- Operating tool via digital communication (HART) or SmartBlue (app)
 - Status signal (as per NAMUR Recommendation NE 107)
 - Plain text display with remedial action

Linearization

The linearization function of the device allows the conversion of the measured value into any unit of length, weight, flow or volume. When operating using DeviceCare and FieldCare, linearization tables for volume calculation in vessels are preprogrammed (see list below).

Pre-programmed linearization curves

- Cylindrical tank
- Spherical tank
- Tank with pyramid bottom
- Tank with conical bottom
- Tank with flat bottom

Other tables of up to 32 value pairs can be entered manually.


Protocol-specific data

HART

| | |
|------------------------------------|---|
| Manufacturer ID | 17 (0x11) |
| Device type ID | 44 (0x112c) |
| HART specification | 7.0 |
| Device description files (DTM, DD) | Information and files under: <ul style="list-style-type: none"> ▪ www.endress.com ▪ www.hartcomm.org |
| HART load | Min. 250 Ω |
| HART device variables | Assignment of HART device variables is fixed and cannot be changed. Measured values for PV (primary variable) Level linearized Advanced diag. measured values for SV (secondary variable) Distance Advanced diag. measured values for TV (tertiary variable) Relative echo amplitude Advanced diag. measured values for QV (quarternary variable) Temperature |
| Supported functions | Additional transmitter status |
| Multidrop current | 4 mA |
| Time for connection setup | < 1 s |

Electrical connection

Cable assignment

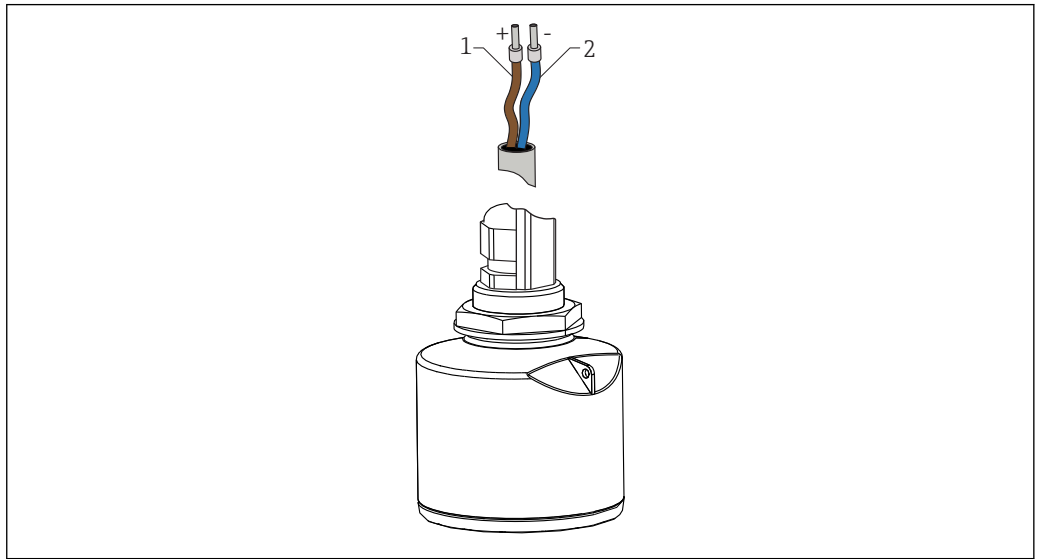

A0028954

2 Cable assignment

- 1 Plus, brown wire
- 2 Minus, blue wire

Supply voltage

An external power supply is necessary.

| Terminal voltage U at device | Maximum load R, depending on supply voltage U ₀ of power supply unit |
|-----------------------------------|---|
| 10.5 to 30 V _{DC} 2-wire | <p>The graph plots Maximum load R [Ω] on the y-axis (0 to 500) against supply voltage U₀ [V] on the x-axis (10 to 30). The load R is 0 Ω for U₀ = 10.5 V, increases linearly to 500 Ω at U₀ = 21.75 V, and remains constant at 500 Ω for U₀ up to 30 V.</p> |

A0029226

Potential equalization

No special measures for potential equalization are required.

In the case of a device for the hazardous area, please comply with the safety instructions in the separate "Safety Instructions" (XA, ZD) document.

Various power supply units can be ordered from Endress+Hauser: see "Accessories" section → 50

Battery operation

The sensor's *Bluetooth*[®] wireless technology communication can be disabled to increase the operating life of the battery.

FMR20 with RIA15

i The RIA15 remote display can be ordered together with the device.

Product structure, feature 620 "Accessory enclosed":



- Option R4 "Remote display RIA15 non-hazardous area, field housing"
- Option R5 "Remote display RIA15 Ex= explosion protection approval, field housing"

i Alternatively it can be ordered separately as an accessory, for details: Technical Information TI01043K and Operating Instructions BA01170K

i The RIA15 process display unit is loop-powered and does not require any external power supply.

The voltage drop to be taken into account is:

- ≤1 V in the standard version with 4 to 20 mA communication
- ≤1.9 V with HART communication
- and an additional 2.9 V if display light is used

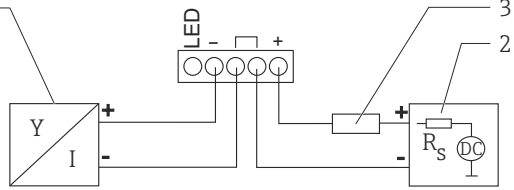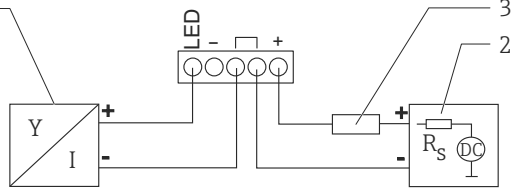
| | Circuit diagram / Description |
|--|--|
| <p>FMR20 connection, HART communication and RIA15 without backlight</p> |  <p style="text-align: right; font-size: small;">A0019567</p> <p>4 FMR20 block diagram, HART with RIA15 process display unit without light</p> <p>1 Micropilot FMR20 2 Power supply 3 HART resistance</p> |
| <p>FMR20 connection, HART communication and RIA15 with backlight</p> |  <p style="text-align: right; font-size: small;">A0019568</p> <p>5 FMR20 block diagram, HART with RIA15 process display unit with light</p> <p>1 Micropilot FMR20 2 Power supply 3 HART resistance</p> |



FMR20, RIA15 with installed HART communication resistor module

 The HART communication module for installation in the RIA15 can be ordered together with the device.

Product structure, feature 620 "Accessory enclosed":

- Option R6 "HART communication resistor hazardous / non-hazardous area"
- The **voltage drop** to be taken into account is max. **7 V**

 Alternatively it can be ordered separately as an accessory, for details: Technical Information TI01043K and Operating Instructions BA01170K
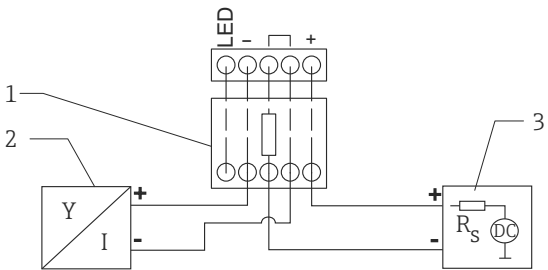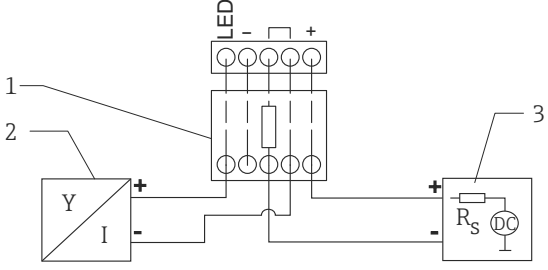
| Circuit diagram / Description | |
|--|--|
| <p>FMR20 connection and RIA15 without backlight</p> |  <p>6 FMR20 block diagram, RIA15 without light, HART communication resistor module</p> <p>1 HART communication resistor module 2 Micropilot FMR20 3 Power supply</p> <p style="text-align: right; font-size: small;">A0020839</p> |
| <p>FMR20 connection and RIA15 with backlight</p> |  <p>7 FMR20 block diagram, RIA15 with light, HART communication resistor module</p> <p>1 HART communication resistor module 2 Micropilot FMR20 3 Power supply</p> <p style="text-align: right; font-size: small;">A0020840</p> |

| | |
|-----------------------------|--|
| Power consumption | Maximum input power: 675 mW |
| Current consumption | <ul style="list-style-type: none"> ▪ Maximum input current: <25 mA ▪ Maximum start-up current: 3.6 mA |
| Start-up time | First stable reading after 20 s (at supply voltage = 24 V _{DC}) |
| Power supply failure | The configuration remains stored in the sensor. |
| Cable specification | <p>An unshielded cable, 2 x 0.75 mm², is used.</p> <p>As per IEC/EN 60079-11 section 10.9, the cable is designed for a tensile strength of 30 N (over a period of 1 h).</p> <p>The sensor is supplied with 5 m (16 ft) cable length as standard. Lengths 10 m (33 ft) and 20 m (66 ft) are available for an additional cost.</p> <p>Lengths can be selected by the user up to an overall length of 300 m (980 ft) and are available by the meter (option "8") or foot (option "A").</p> |

Overvoltage protection

The device is equipped with integrated overvoltage protection.

Performance characteristics

Reference operating conditions

- Temperature = +24 °C (+75 °F) ±5 °C (±9 °F)
- Pressure = 960 mbar abs. (14 psia) ±100 mbar (±1.45 psi)
- Humidity = 60 % ±15 %
- Reflector: metal plate with a minimum diameter of ≥ 1 m (40 in)
- No major interference reflections inside the signal beam

Maximum measured error


Typical data under reference operating conditions: DIN EN 61298-2, percentage values in relation to the span.

| Device | Value | Output | |
|-----------------------------------|--|-----------------------|-----------------------|
| | | digital ¹⁾ | analog, ²⁾ |
| FMR20 40 mm (1.5 in)Antenna | Sum of non-linearity, non-repeatability and hysteresis | ± 2 mm (0.08 in) | ± 0.02 % |
| | Offset/Zero | ± 4 mm (0.16 in) | ± 0.03 % |
| FMR20 80 mm (3 in)Antenna | Sum of non-linearity, non-repeatability and hysteresis | ± 2 mm (0.08 in) | ± 0.02 % |
| | Offset/Zero | ± 4 mm (0.16 in) | ± 0.03 % |

1) , HART, SmartBlue (app)

2) relevant only to 4-20mA current output; add error of the analog value to the digital value

Differing values in near-range applications

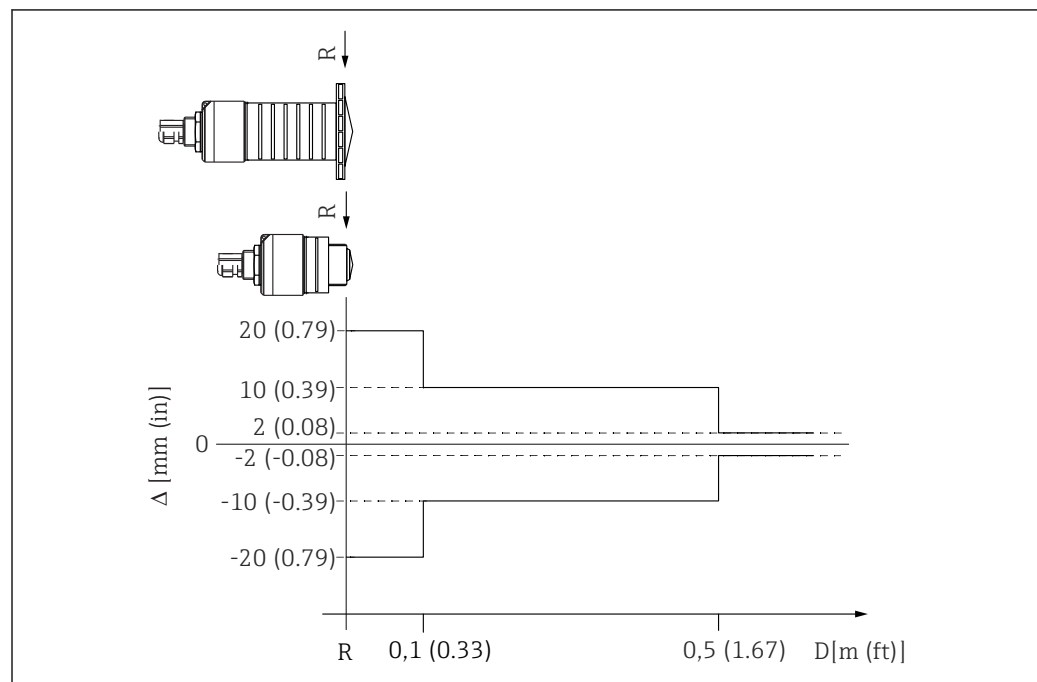

8 Maximum measured error in near-range applications; values for standard version

Δ Maximum measured error

R Reference point of the distance measurement

D Distance from the reference point of the antenna

Measured value resolution

Dead band as per EN61298-2:

- Digital: 1 mm (0.04 in)
- Analog: 4 μA

Response time

The response time can be configured. The following step response times (as per DIN EN 61298-2)¹⁾ apply if the damping is switched off:

| Tank height | Sampling rate | Response time |
|----------------|-------------------|---------------|
| < 20 m (66 ft) | 1 s ⁻¹ | < 3 s |

Influence of ambient temperature

The measurements are carried out in accordance with EN 61298-3.


- Digital (HART, *Bluetooth*[®] wireless technology):
Standard version: average $T_K = \pm 3 \text{ mm (0.12 in)}/10 \text{ K}$
- Analog (current output):
 - Zero point (4 mA): average $T_K = 0.02 \text{ %}/10 \text{ K}$
 - Span (20 mA): average $T_K = 0.05 \text{ %}/10 \text{ K}$

1) According to DIN EN 61298-2 the step response time is the time which passes after a sudden change of the input signal until the output signal assumes 90% of the steady-state value for the first time.

Installation

Installation conditions

Installation types

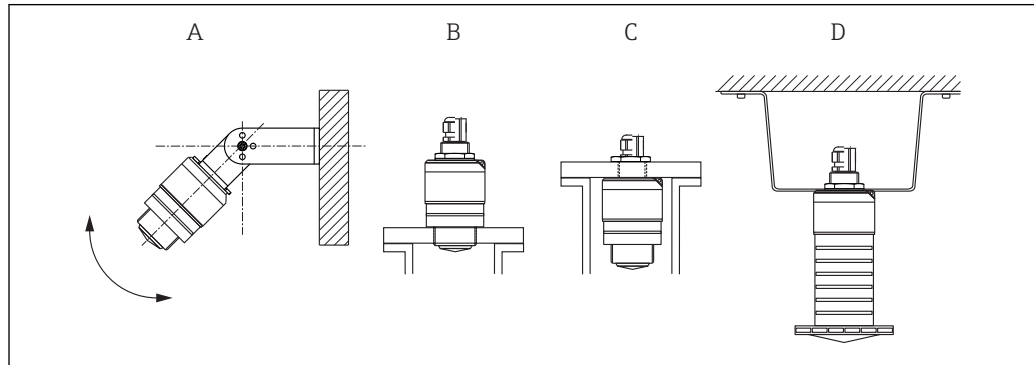


A0030605

- 9 Wall, ceiling or nozzle installation
- A Wall or ceiling mount, adjustable
 - B Mounted at front thread
 - C Mounted at rear thread
 - D Ceiling installation with counter nut (included in delivery)

Caution! The sensor cable is not designed as supporting cable. Do not use as a suspension wire.

Nozzle installation

The antenna should be just out of the nozzle for optimum measurement. The interior of the nozzle must be smooth and may not contain any edges or welded joints. The edge of the nozzle should be rounded if possible. The maximum nozzle length **L** depends on the nozzle diameter **D**. Please note the specified limits for the diameter and length of the nozzle.

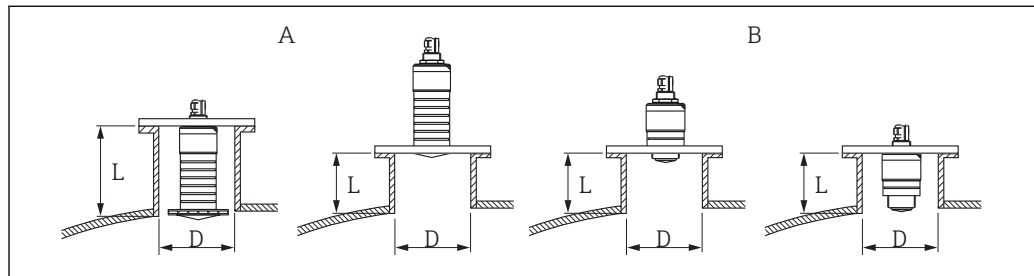


A0028413

- 10 FMR20 nozzle installation
- A FMR20 80 mm (3 in) antenna
 - B FMR20 40 mm (1.5 in) antenna

| | 80 mm (3 in) Antenna, inside nozzle | 80 mm (3 in) Antenna, outside nozzle | 40 mm (1.5 in) Antenna, outside nozzle | 40 mm (1.5 in) Antenna, inside nozzle |
|---|-------------------------------------|--------------------------------------|--|---------------------------------------|
| D | min. 120 mm (4.72 in) | min. 80 mm (3 in) | min. 40 mm (1.5 in) | min. 80 mm (3 in) |
| L | max. 205 mm (8.07 in) + D x 4.5 | max. D x 4.5 | max. D x 1.5 | max. 140 mm (5.5 in) + D x 1.5 |

Orientation

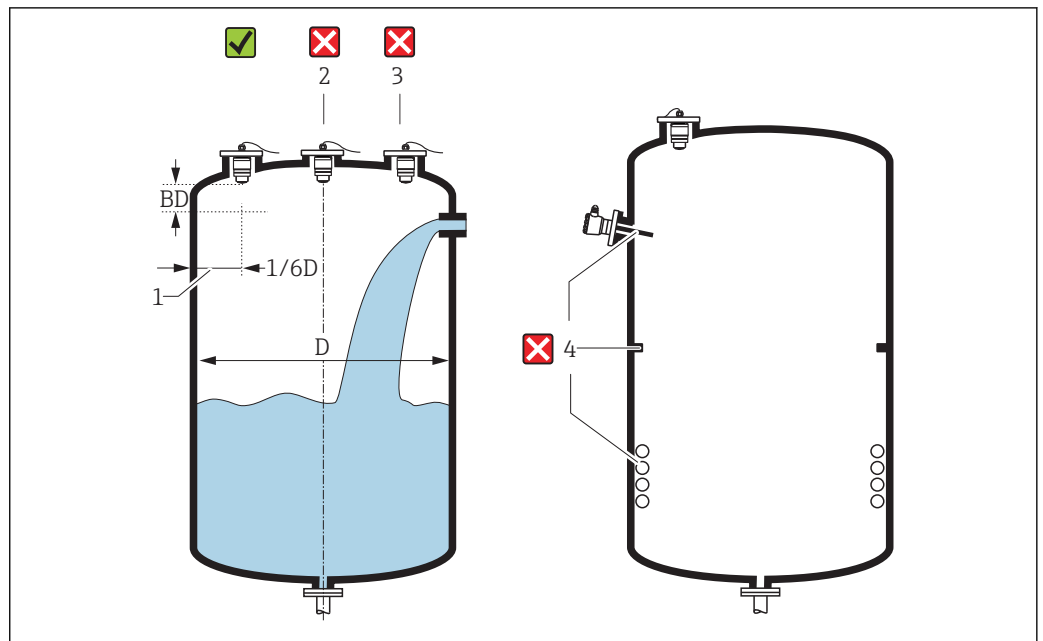


11 Tank installation position

- If possible install the sensor so that its lower edge projects into the vessel.
- Do not install the sensor in the middle of the tank (2). We recommend leaving a distance (1) between the sensor and the tank wall measuring $1/6$ of the tank diameter. Recommended distance **A** wall - nozzle outer edge: $\sim 1/6$ of the tank diameter **D**. However, the device must not under any circumstances be mounted closer than 15 cm (5.91 in) to the tank wall.
- Avoid measurements through the filling curtain (3).
- Avoid equipment (4) such as limit switches, temperature sensors, baffles, heating coils etc.
- Multiple devices can be operated in one tank without influencing each other.
- No signals are analyzed within the Blocking distance. It can therefore be used to suppress interference signals (e.g. the effects of condensate) close to the antenna. By default an automatic Blocking distance of at least 0.1 m (0.33 ft) is preset. However it can be manually overwritten (even 0 m (0 ft) is allowed).
Automatic calculation:
Blocking distance = Empty calibration - Full calibration - 0.2 m (0.656 ft).
The **Blocking distance** parameter is recalculated according to this formula every time a new value is entered into the **Empty calibration** parameter or **Full calibration** parameter.
If this calculation results in a value < 0.1 m (0.33 ft), the blocking distance of 0.1 m (0.33 ft) is used instead.

Alignment


- Align the antenna vertically to the product surface.
- Align the eyelet with the mounting eye as well as possible towards the tank wall.

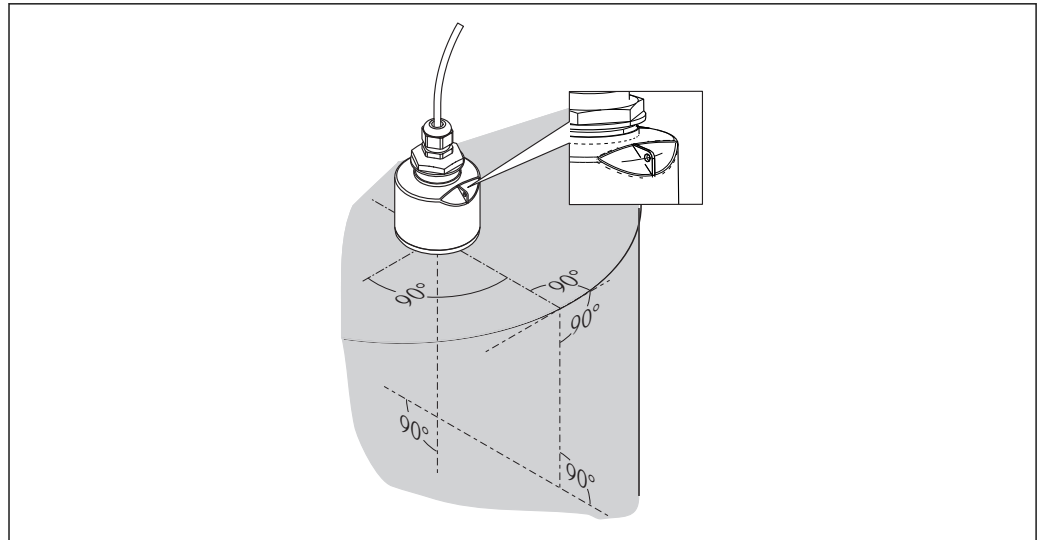

A0028927

12 Sensor alignment when mounting in tank

Beam angle

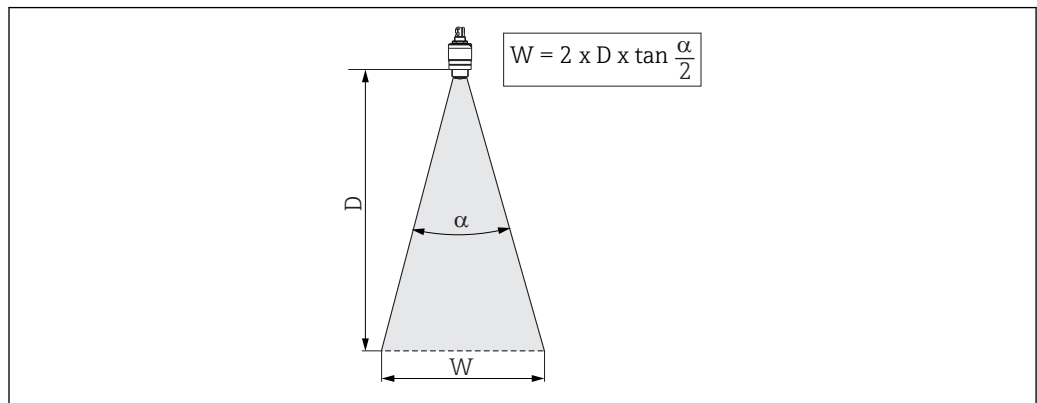

A0029053-EN

13 Relationship between beam angle α , distance D and beamwidth diameter W


The beam angle is defined as the angle α at which the power density of the radar waves reaches half the value of the maximum power density (3dB width). Microwaves are also emitted outside the signal beam and can be reflected off interfering installations.

Beam diameter W as a function of beam angle α and measuring distance D .

| FMR20 | | |
|---------------------|----------------------|-------------------|
| Antenna size | 40 mm (1.5 in) | 80 mm (3 in) |
| Beam angle α | 30° | 12° |
| Distance (D) | Beamwidth diameter W | |
| 3 m (9.8 ft) | 1.61 m (5.28 ft) | 0.63 m (2.1 ft) |
| 5 m (16.4 ft) | 2.68 m (8.79 ft) | 1.05 m (3.45 ft) |
| 10 m (33 ft) | 5.36 m (17.59 ft) | 2.1 m (6.9 ft) |
| 15 m (49 ft) | | 3.15 m (10.34 ft) |
| 20 m (66 ft) | | 4.2 m (13.79 ft) |

Measurement in plastic vessels

If the outer wall of the vessel is made of a non-conductive material (e.g. GFR) microwaves can also be reflected off interfering installations outside of the vessel (e.g. metallic pipes (1), ladders (2), grates (3), ...). Therefore there should be no such interfering installations in the signal beam. For more information, please contact Endress+Hauser.

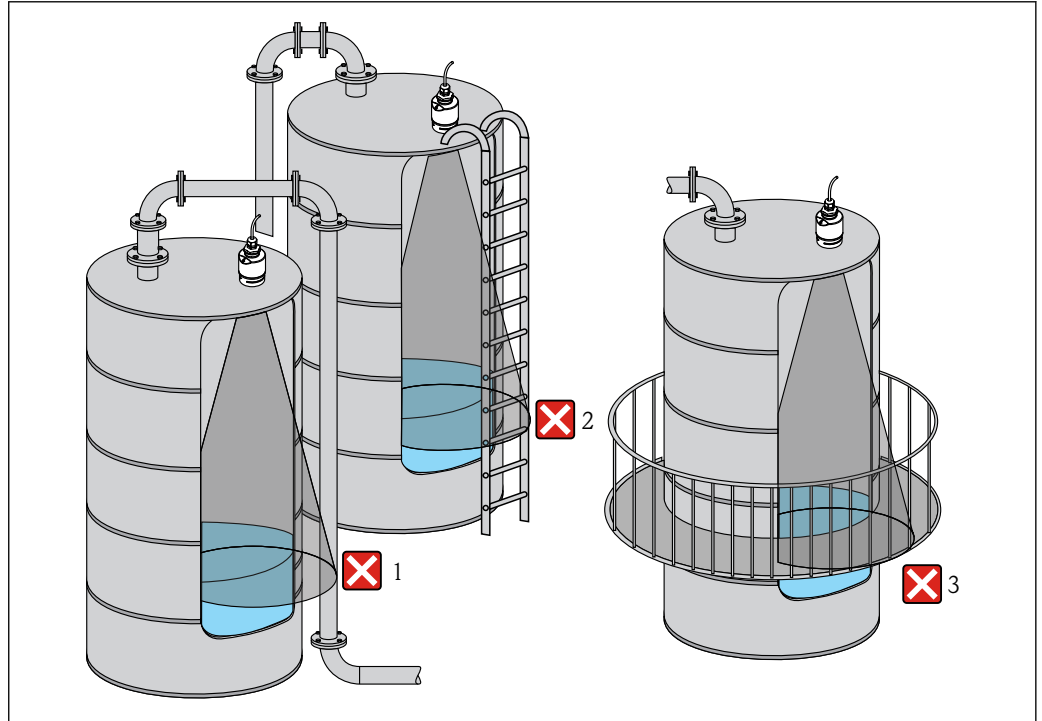


14 Measurement in a plastic vessel


A0029540


Weather protection cover


For outdoor use, the use of a weather protection cover(1) is recommended

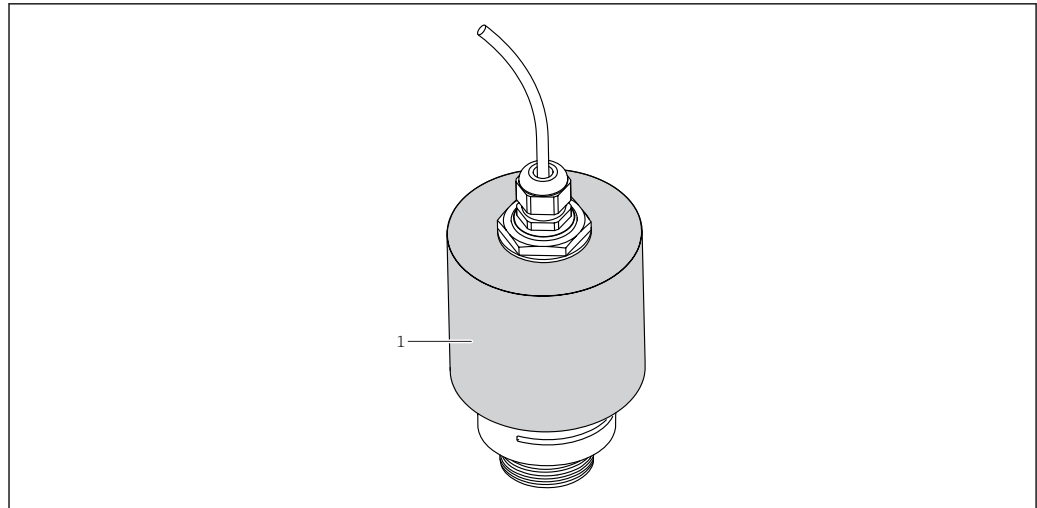



A0031277

 15 Weather protection cover, e.g with 40 mm (1.5") antenna

 The sensor is not completely covered in the case of the 40 mm (1.5 in) antenna or the 80 mm (3 in) antenna.

The weather protection cover is available as an accessory. →  37


 The sensor is not completely covered.

The weather protection cover is available as an accessory. →  37

Free-field measurement with flooding protection tube

The flooding protection tube guarantees a definitive analysis of the maximum level even in the event that the sensor is completely flooded.

In free-field installations and / or in applications where there is a risk of flooding, it is recommended to use a flooding protection tube

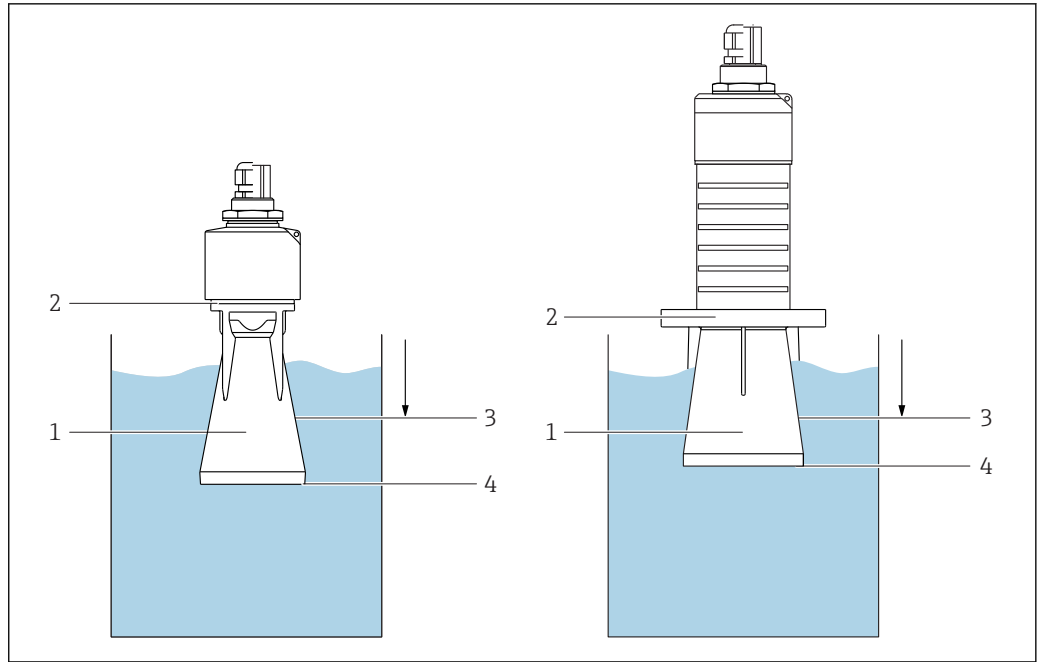


A0031093

16 Function of flooding protection tube

- 1 Air pocket
- 2 O-ring (EPDM) seal
- 3 Blocking distance
- 4 Max. Level

i The flooding protection tube is available as an accessory. → 37

Installation with mounting bracket, adjustable

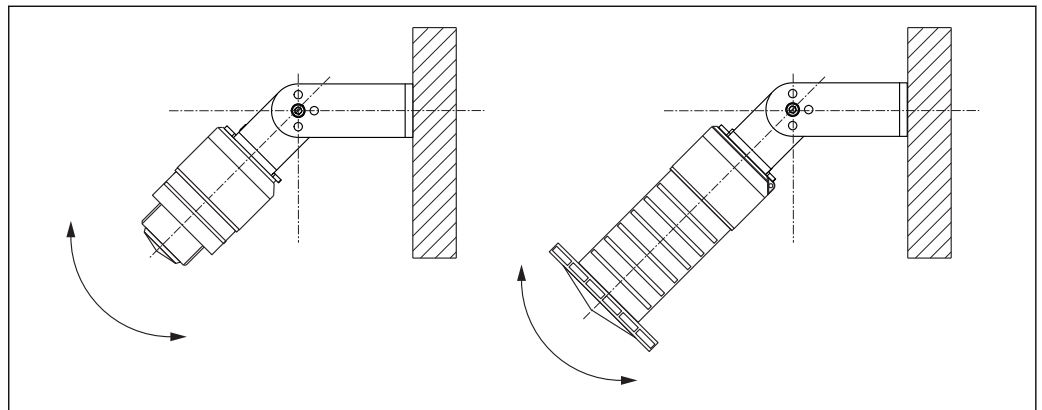

A0030606

17 Installation with mounting bracket, adjustable

- Wall or ceiling installation is possible.
- Using the mounting bracket, position the antenna so that it is perpendicular to the product surface.


NOTICE

There is no conductive connection between the mounting bracket and transmitter housing.
Risk of electrostatic charge.

- ▶ Integrate the mounting bracket in the local potential equalization system.

i The mounting bracket is available as an accessory. → 37

Cantilever installation, with pivot

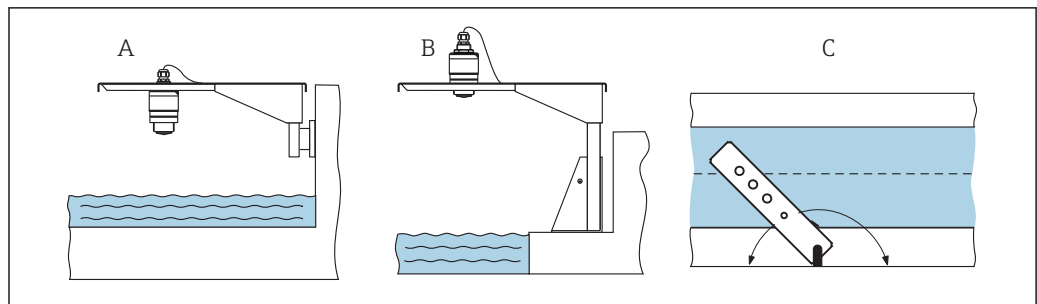

A0028412

18 Cantilever installation, with pivot

A Installation with cantilever and wall bracket

B Installation with cantilever and mounting frame



C The cantilever can be turned (e.g. in order to position the sensor over the center of the channel, for example)

 The cantilever, wall bracket and mounting frame are available as accessories. →  37

Post-installation check

| | |
|--------------------------|---|
| <input type="checkbox"/> | Is the device undamaged (visual inspection)? |
| <input type="checkbox"/> | Is the device adequately protected from wet conditions and direct sunlight? |
| <input type="checkbox"/> | Is the device properly secured? |


Environment

| | |
|--|---|
| Ambient temperature range | <p>Measuring device: -40 to +80 °C (-40 to +176 °F)</p> <p> It may not be possible to use the Bluetooth connection at ambient temperatures > 60 °C (140 °F).</p> <p>Outdoor operation in strong sunlight:</p> <ul style="list-style-type: none"> ■ Mount the device in the shade. ■ Avoid direct sunlight, particularly in warm climatic regions. ■ Use a weather protection cover →  37. |
| Storage temperature | -40 to +80 °C (-40 to +176 °F) |
| Climate class | DIN EN 60068-2-38 (test Z/AD) |
| Installation height as per IEC 61010-1 Ed.3 | Generally up to 2 000 m (6 600 ft) above sea level. |
| Degree of protection | Tested acc. to: IP68, NEMA 6P (24 h at 1.83 m under water) |
| Vibration resistance | DIN EN 60068-2-64/IEC 60068-2-64: 20 to 2 000 Hz, 1 (m/s ²)/Hz |
| Cleaning the antenna | <p>The antenna may become contaminated depending on the application. Emission and reception of microwaves can thus be hindered. The level of contamination leading to an error depends firstly on the medium and secondly on the reflectivity, mainly determined by the dielectric constant ϵ_r.</p> <p>If the medium tends to cause contamination and buildup, cleaning on a regular basis is recommended. Care must be taken to ensure the antenna is not damaged in the process of mechanical or hose-down cleaning. Material compatibility must be taken into account if cleaning agents are used! The maximum permitted temperatures must not be exceeded.</p> |
| Electromagnetic compatibility (EMC) | Electromagnetic compatibility in accordance with all of the relevant requirements outlined in the EN 61000 series and NAMUR Recommendation EMC (NE 21). For details, please refer to the Declaration of Conformity ²⁾ |

2) Available for download at www.endress.com.

Process

Process temperature, process pressure **FMR20**

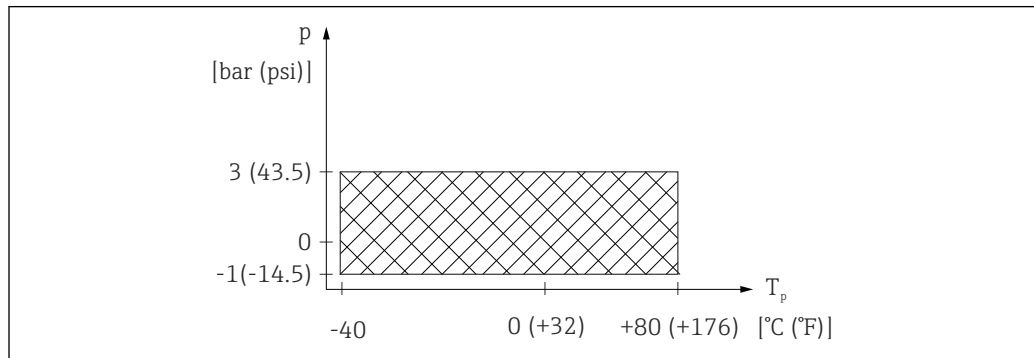

A0029007-EN

19 FMR20: Permitted range for process temperature and process pressure

| Feature 100 "Process connection" | Process temperature range | Process pressure range |
|--|-----------------------------------|--|
| <ul style="list-style-type: none"> ▪ VEE: Thread ASME MNPT1-1/2; PVDF ▪ VFE: Thread ASME MNPT2; PVDF ▪ WFE: Thread ISO228 G1-1/2; PVDF ▪ WFE: Thread ISO228 G2; PVDF | -40 to +80 °C (-40 to +176 °F) | $p_{rel} =$ -1 to 3 bar (-14.5 to 43.5 psi) $p_{abs} < 4 \text{ bar (58 psi)}$ ¹⁾ |
| <ul style="list-style-type: none"> ▪ RPF: UNI slip-on flange 3"/DN80/80; PP ▪ RRF: UNI slip-on flange 4"/DN100/100; PP ▪ RSF: UNI slip-on flange 6"/DN150/150; PP | -40 to +80 °C (-40 to +176 °F) | $p_{rel} =$ -1 to 1 bar (-14.5 to 14.5 psi) $p_{abs} < 4 \text{ bar (58 psi)}$ ²⁾ |

- 1) The pressure range may be further restricted in the event of a CRN approval.
- 2) The pressure range may be further restricted in the event of a CRN approval.

Dielectric constant

For liquids

$$\epsilon_r \geq 4$$


i For dielectric constants (DC values) of many media commonly used in various industries refer to:

- the Endress+Hauser DC manual (CP01076F)
- the Endress+Hauser "DC Values App" (available for Android and iOS)

Mechanical construction

Dimensions

FMR20 with G 1-1/2 or MNPT 1-1/2 thread

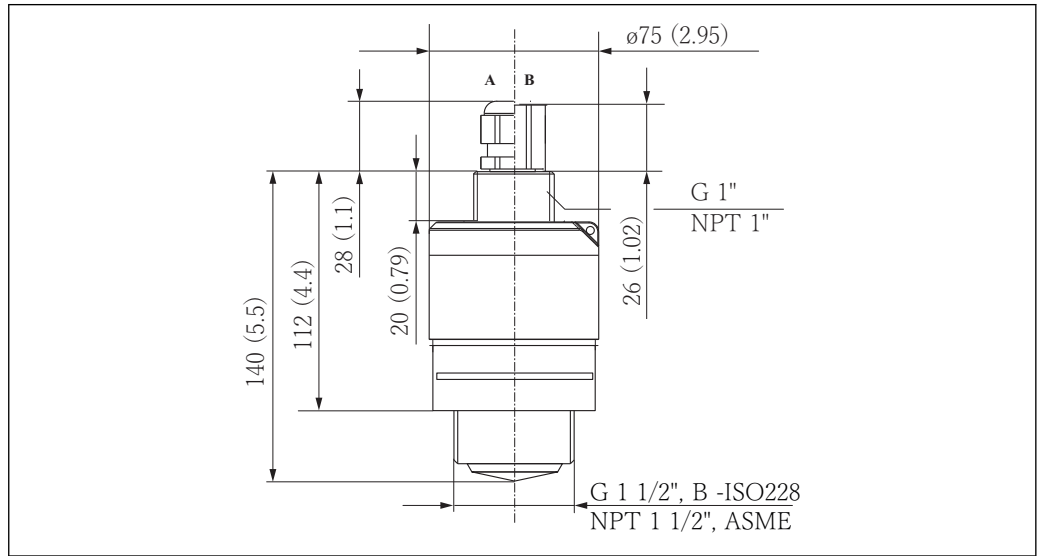


20 Dimensions of FMR20 with G 1-1/2 or MNPT 1-1/2 thread, engineering unit: mm (in)

Applies to the following device versions

- **Feature 095 "Process connection rear side"**
 - VCE: Thread ASME MNPT1; PVDF
 - WDE: Thread G1 ISO228; PVDF
- **Feature 100 "Process connection front side"**
 - VEE: Thread ASME MNPT1-1/2; PVDF
 - WFE: Thread ISO228 G1-1/2; PVDF

FMR20 with G 2 or MNPT 2 thread

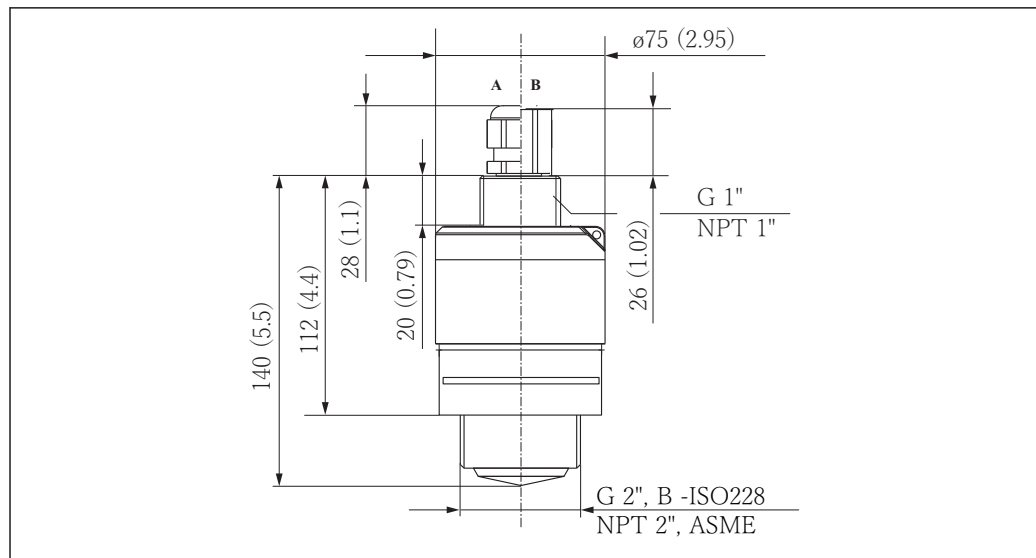


A0028806

21 Dimensions of FMR20 with G 2 or MNPT 2 thread, engineering unit: mm (in)

Applies to the following device versions

- **Feature 095 "Process connection rear side"**
 - VCE: Thread ASME MNPT1; PVDF
 - WDE: Thread G1 ISO228; PVDF
- **Feature 100 "Process connection front side"**
 - VFE: Thread ASME MNPT2; PVDF
 - WGE: Thread ISO228 G2; PVDF

FMR20 with flooding protection tube

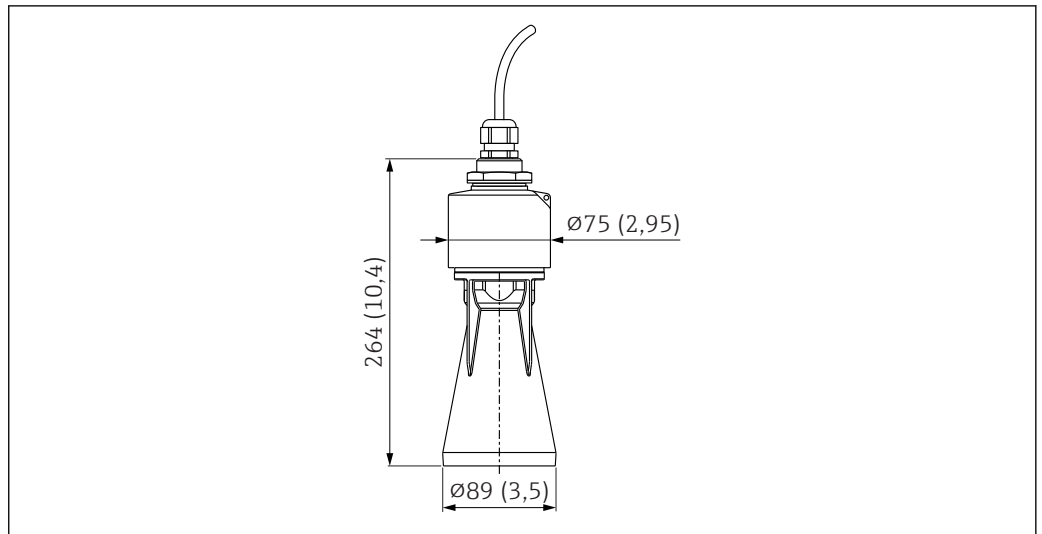

A0030266

22 Dimensions of FMR20 with flooding protection tube, engineering unit: mm (in)

Applies to the following device versions


■ **Feature 100 "Process connection front side"**

WFE: Thread ISO228 G1-1/2; PVDF

■ **Feature 620 "Accessory enclosed"**

Option R7 "Flooding protection tube, metallized PBT-PC suitable for 40 mm (1.5 in) antenna with process connection on front G1-1/2".

FMR20 80 mm (3 in) antenna

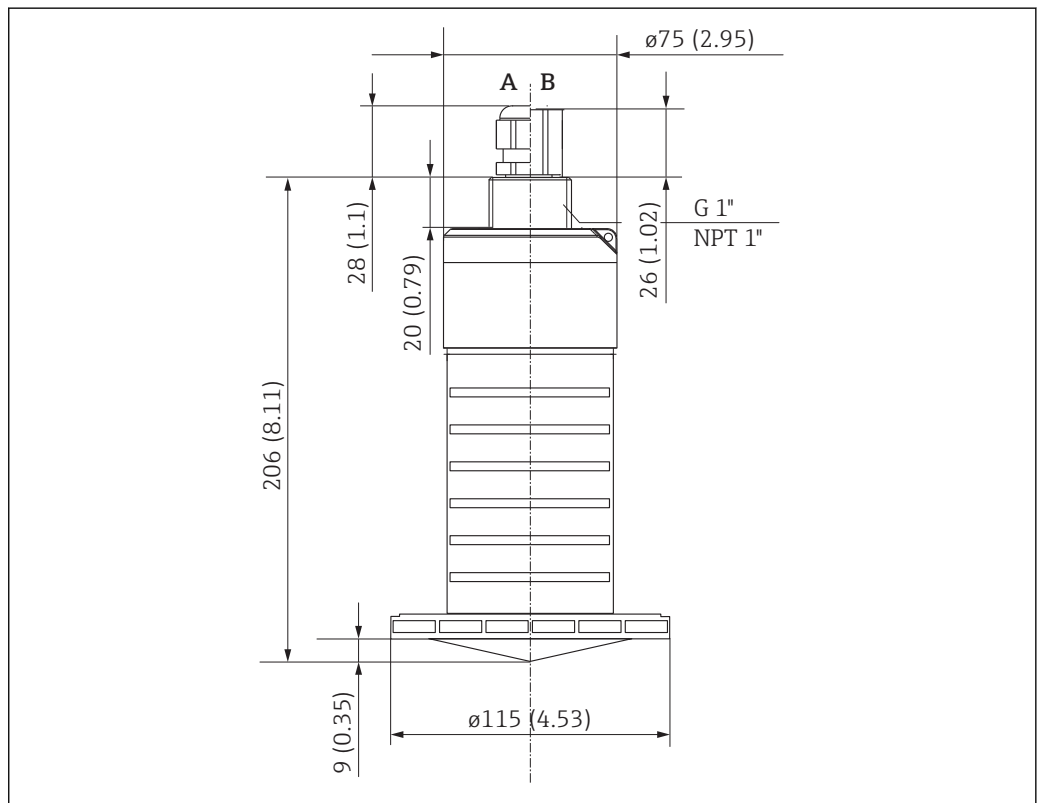


A0028807

23 Dimensions of FMR20 80 mm (3 in) antenna; engineering unit: mm (in)

Applies to the following device versions
Feature 095 "Process connection rear side"
– VCE: Thread ASME MNPT1; PVDF
– WDE: Thread G1 ISO228; PVDF

FMR20 80 mm (3 in) antenna with flooding protection tube

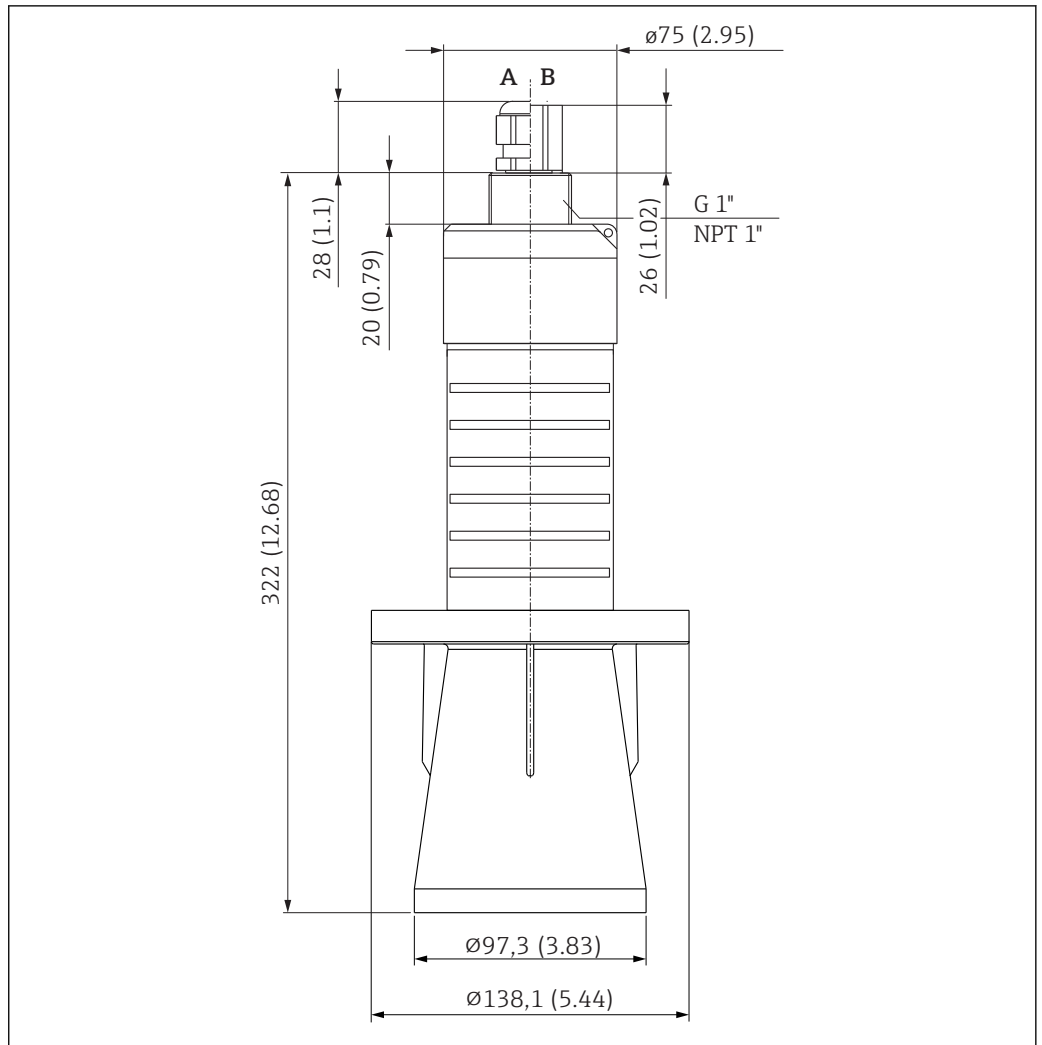


24 Dimensions of FMR20 80 mm (3 in) antenna with flooding protection tube; engineering unit: mm (in)

Applies to the following device versions

- **Feature 100 "Process connection front side"**
XRO: Mounting customer side w/o flange
- **Feature 620 "Accessory enclosed"**
Option R8 "Flooding protection tube, metallized PBT-PC suitable for 80 mm (3 in) antenna

FMR20 80 mm (3 in) antenna with UNI slip-on flange 3"/DN80

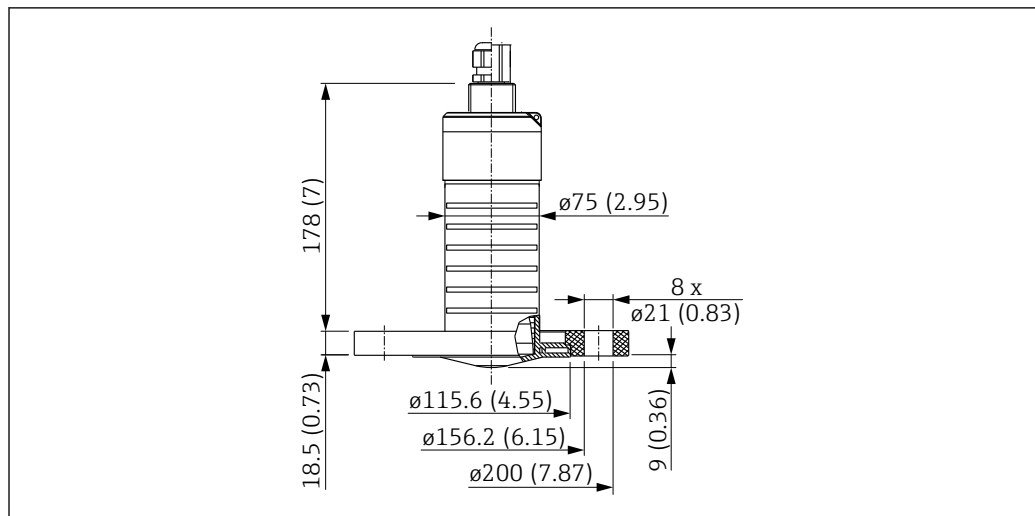

A0028813

25 Dimensions of FMR20 80 mm (3 in) antenna with slip-on flange 3"/DN80, engineering unit: mm (in)

Applies to the following device versions


- Feature 095 "Process connection rear side"

- VCE: Thread ASME MNPT1; PVDF
- WDE: Thread G1 ISO228; PVDF

- Feature 100 "Process connection front side"

- RPF: UNI slip-on flange 3"/DN80/80; PP, suitable for 3" 150 lbs/DN80 PN16/10K 80

FMR20 80 mm (3 in) antenna with slip-on flange 4"/DN100

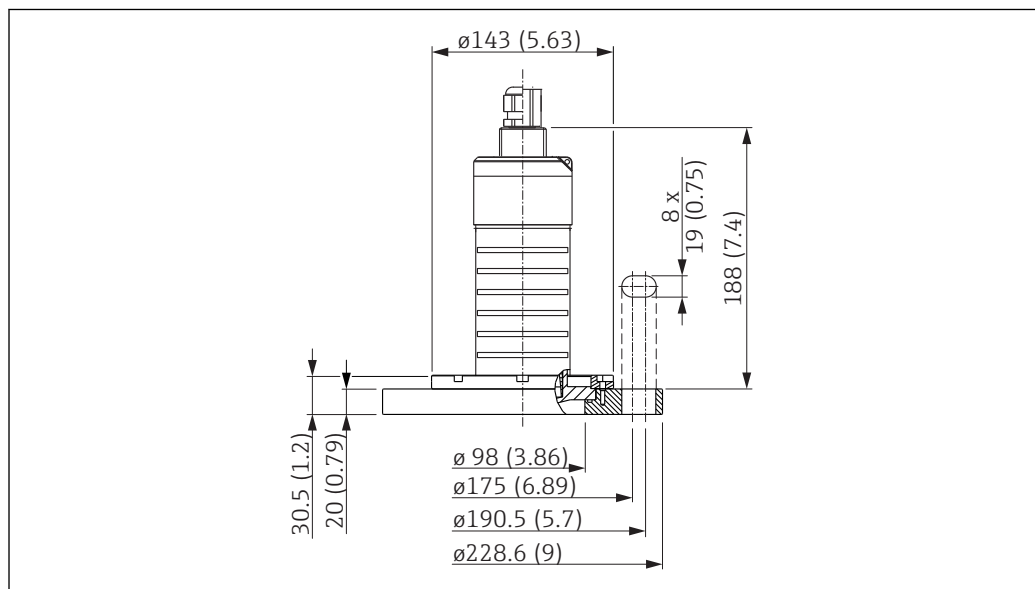

A0028816

26 Dimensions of FMR20 80 mm (3 in) antenna with slip-on flange 4"/DN100, engineering unit: mm (in)

Applies to the following device versions


- Feature 095 "Process connection rear side"

- VCE: Thread ASME MNPT1; PVDF
- WDE: Thread G1 ISO228; PVDF

- Feature 100 "Process connection front side"

- RRF: UNI slip-on flange 4"/DN100/100; PP, suitable for 4" 150 lbs/DN100 PN16/10K 100

FMR20 80 mm (3 in) antenna with slip-on flange 6"/DN150

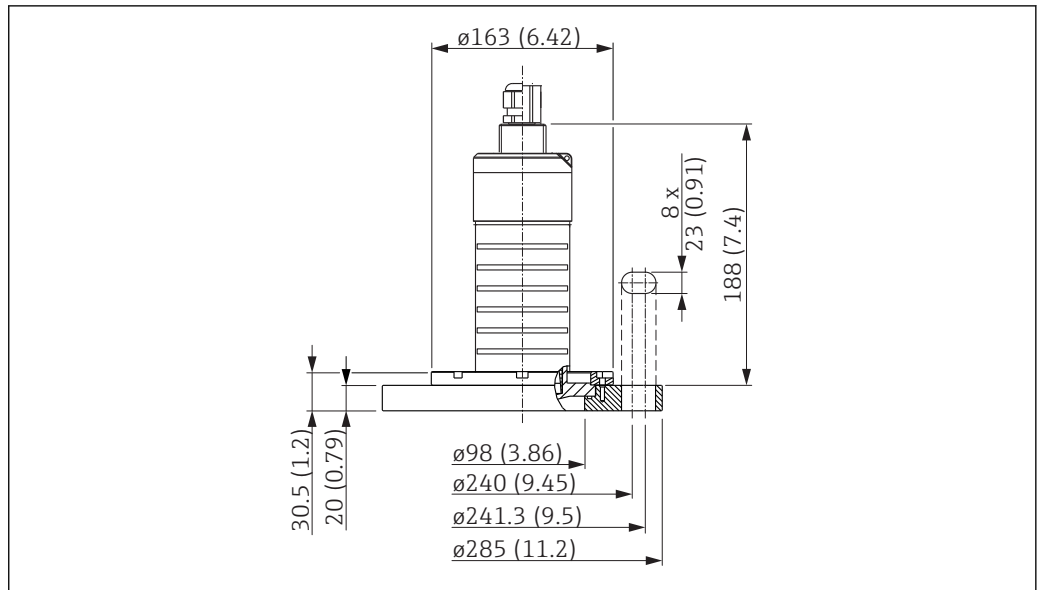

A0028818

27 Dimensions of FMR20 80 mm (3 in) antenna with slip-on flange 6"/DN150, engineering unit: mm (in)

Applies to the following device versions

■ **Feature 095 "Process connection rear side"**

- VCE: Thread ASME MNPT1; PVDF
- WDE: Thread G1 ISO228; PVDF


■ **Feature 100 "Process connection front side"**

- RSF: UNI slip-on flange 6"/DN150/150; PP, suitable for 6" 150 lbs/DN150 PN16/10K 150

Weight

| Micropilot | Weight (incl. 5 m (16.4 ft) cable) |
|-------------------------------|------------------------------------|
| FMR20, 40 mm (1.5 in) antenna | Approx. 2.5 kg (5.5 lb) |
| FMR20, 80 mm (3 in) antenna | Approx. 2.8 kg (6.2 lb) |

Housing/process connection materials

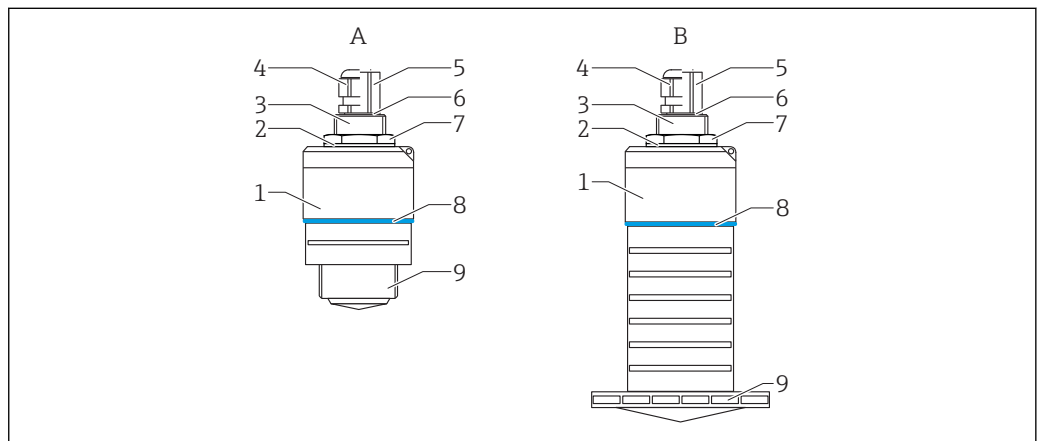

A0028416

28 FMR20 materials

- A 40 mm (1.5 in) Antenna
- B 80 mm (3 in) Antenna

| Item | Component part | Material |
|------|----------------|----------|
| 1 | Sensor housing | PVDF |
| 2 | Seal | EPDM |

| Item | Component part | Material |
|------|-------------------------------|---------------------|
| 3 | Process connection rear side | PVDF |
| 4 | Cable gland | PA |
| 5 | Pipe adapter | CuZn, nickel-plated |
| 6 | O-ring | EPDM |
| 7 | Counter nut | PA6.6 |
| 8 | Design ring | PBT PC |
| 9 | Process connection front side | PVDF |

Connecting cable


Available cable length: 1 to 30 m (3.3 to 98 ft)

If longer cable lengths are required, an extension cable must be used.

In this case, the total cable length (sensor cable + extension cable) must not exceed 300 m (984 ft).

Material : PVC

Counter nut G 1

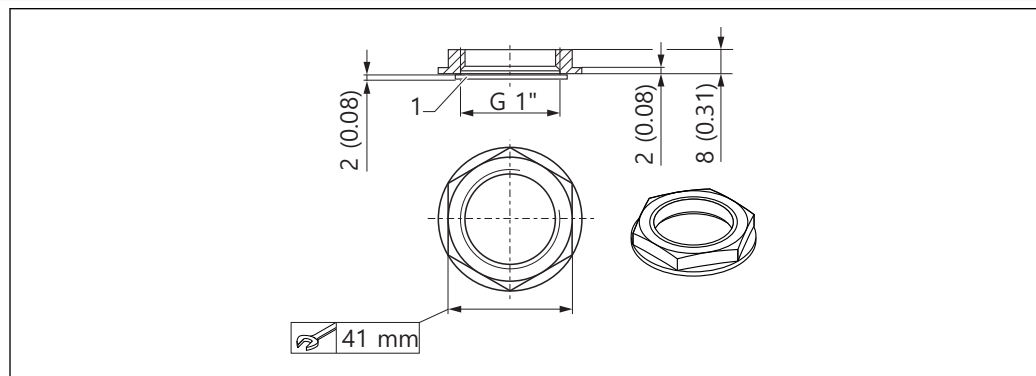

29 Dimensions of counter nut G 1, engineering unit: mm (in)

1 Seal


- The counter nut with seal (EPDM) is included in the scope of supply.
- Material: PA6.6

Operability

Operating concept

- 4 to 20 mA, HART
- Menu guidance with brief explanations of the individual parameter functions in the operating tool
- Optional: SmartBlue (app) via Bluetooth® wireless technology

Via Bluetooth® wireless technology

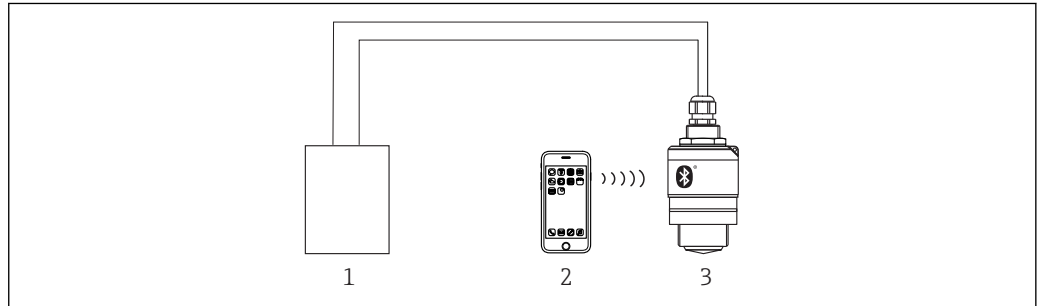


A0028895

30 Possibilities for remote operation via Bluetooth® wireless technology

- 1 Transmitter power supply unit
- 2 Smartphone / tablet with SmartBlue (app)
- 3 Transmitter with Bluetooth® wireless technology

Via HART protocol

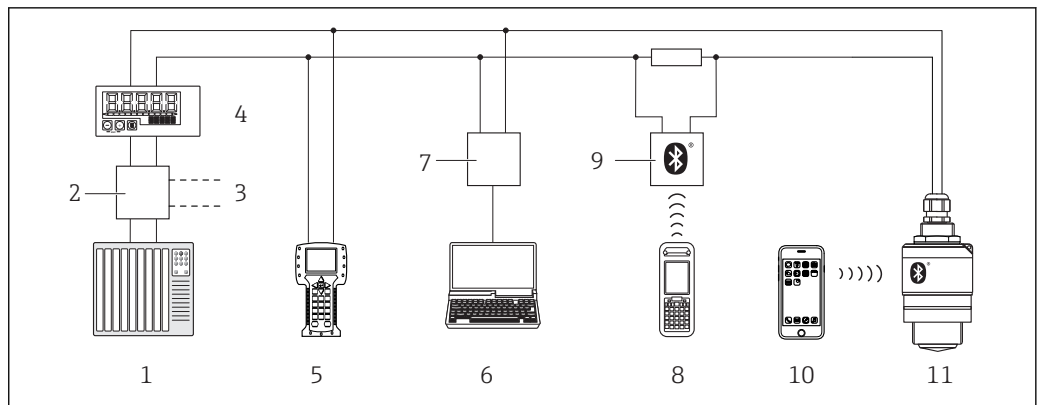





A0028894

31 Options for remote operation via HART protocol

- 1 PLC (programmable logic controller)
- 2 Transmitter power supply unit, e.g. RN221N (with communication resistor)
- 3 Connection for Commubox FXA195 and Field Communicator 375, 475
- 4 RIA15 loop-powered process display unit
- 5 Field Communicator 475
- 6 Computer with operating tool (e.g. FieldCare, DeviceCare, AMS Device Manager, SIMATIC PDM)
- 7 Commubox FXA195 (USB)
- 8 Field Xpert SFX350/SFX370
- 9 VIATOR with Bluetooth® wireless technology modem
- 10 Smartphone / tablet with SmartBlue (app)
- 11 Transmitter with Bluetooth® wireless technology

Certificates and approvals

| | |
|--|---|
| CE mark | <p>The measuring system meets the legal requirements of the applicable EC guidelines. These are listed in the corresponding EC Declaration of Conformity together with the standards applied.</p> <p>Endress+Hauser confirms successful testing of the device by affixing to it the CE mark.</p> |
| RoHS | <p>The measuring system complies with the substance restrictions of the Restriction on Hazardous Substances Directive 2011/65/EU (RoHS 2).</p> |
| RCM-Tick marking | <p>The supplied product or measuring system meets the ACMA (Australian Communications and Media Authority) requirements for network integrity, interoperability, performance characteristics as well as health and safety regulations. Here, especially the regulatory arrangements for electromagnetic compatibility are met. The products are labelled with the RCM- Tick marking on the name plate.</p> <div data-bbox="408 667 1439 801" style="text-align: center;">  </div> <p style="text-align: right; font-size: small;">A0029561</p> |
| Ex-Zulassung | <ul style="list-style-type: none"> ■ Non-hazardous area ■ ATEX II 1 G Ex ia IIC T4 Ga ■ ATEX II 1/2 G Ex ia IIC T4 Ga/Gb ■ CSA C/US General Purpose ■ CSA C/US IS C.I Div.1 Gr.A-D, AEx ia / Ex ia T4 ■ IEC Ex ia IIC T4 Ga/Gb <p>Additional safety instructions must be followed for use in hazardous areas. Please refer to the separate "Safety Instructions" (XA) document included in the delivery. Reference to the applicable XA can be found on the nameplate.</p> <p> Details on the available certificates and associated XAs can be found in the Associated documentation section under Safety instructions: →  51.</p> |
| Explosion-protected smartphones and tablets | <p>Only mobile end devices with Ex approval may be used in hazardous areas.</p> |
| Pressure Equipment Directive | <p>The Micropilot does not fall within the scope of Pressure Equipment Directive 97/23/EC as it does not have a pressurized housing as defined in Article 1, Section 2.1.4 of the directive.</p> |
| Radio standard EN 302729-1/2 | <p>Micropilot FMR20 devices comply with the LPR (Level Probing Radar) radio standard EN 302729-1/2. The devices are approved for unrestricted use inside and outside of closed vessels in countries of the EU and EFTA that have implemented this standard.</p> <p>The following countries are those that have currently implemented the directive:</p> <p>Belgium, Bulgaria, Germany, Denmark, Estonia, France, Greece, UK, Ireland, Iceland, Italy, Liechtenstein, Lithuania, Latvia, Malta, The Netherlands, Norway, Austria, Poland, Portugal, Romania, Sweden, Switzerland, Slovakia, Spain, Czech Republic and Cyprus.</p> <p>Implementation is still underway in all of the countries not listed.</p> <p>Please note the following for operation of the devices outside of closed vessels:</p> <ol style="list-style-type: none"> 1. The device must be installed according to the instructions mentioned in the chapter "Installation". →  20 2. Installation must be carried out by properly trained, expert staff. 3. The device antenna must be installed in a fixed location pointing vertically downwards. 4. The installation site must be located at a distance of 4 km from the astronomy stations listed below or otherwise approval must be provided by the relevant authority. If the device is installed at a distance of 4 to 40 km from one of the listed stations, it must not be installed at a height of more than 15 m (49 ft) above the ground. |

Astronomy stations

| Country | Name of the station | Latitude | Longitude |
|---------------|---------------------|-----------------|----------------|
| Germany | Effelsberg | 50°31'32" North | 06°53'00" East |
| Finland | Metsähovi | 60°13'04" North | 24°23'37" East |
| | Tuorla | 60°24'56" North | 24°26'31" East |
| France | Plateau de Bure | 44°38'01" North | 05°54'26" East |
| | Floirac | 44°50'10" North | 00°31'37" West |
| Great Britain | Cambridge | 52°09'59" North | 00°02'20" East |
| | Damhall | 53°09'22" North | 02°32'03" West |
| | Jodrell Bank | 53°14'10" North | 02°18'26" West |
| | Knockin | 52°47'24" North | 02°59'45" West |
| | Pickmere | 53°17'18" North | 02°26'38" West |
| Italy | Medicina | 44°31'14" North | 11°38'49" East |
| | Noto | 36°52'34" North | 14°59'21" East |
| | Sardinia | 39°29'50" North | 09°14'40" East |
| Poland | Fort Skala Krakow | 50°03'18" North | 19°49'36" East |
| Russia | Dmitrov | 56°26'00" North | 37°27'00" East |
| | Kalyazin | 57°13'22" North | 37°54'01" East |
| | Pushchino | 54°49'00" North | 37°40'00" East |
| | Zelenchukskaya | 43°49'53" North | 41°35'32" East |
| Sweden | Onsala | 57°23'45" North | 11°55'35" East |
| Switzerland | Bleien | 47°20'26" North | 08°06'44" East |
| Spain | Yebes | 40°31'27" North | 03°05'22" West |
| | Robledo | 40°25'38" North | 04°14'57" West |
| Hungary | Penc | 47°47'22" North | 19°16'53" East |



As a general rule, the requirements outlined in EN 302729-1/2 must be observed.

FCC / Industry Canada

This device complies with Part 15 of the FCC Rules [and with Industry Canada licence-exempt RSS standard(s)]. Operation is subject to the following two conditions: (1) this device may not cause harmful interference, and (2) this device must accept any interference received, including interference that may cause undesired operation.

Le présent appareil est conforme aux CNR d'Industrie Canada applicables aux appareils radio exempts de licence. L'exploitation est autorisée aux deux conditions suivantes: (1) l'appareil ne doit pas produire de brouillage, et (2) l'utilisateur de l'appareil doit accepter tout brouillage radioélectrique subi, même si le brouillage est susceptible d'en compromettre le fonctionnement.

[Any] Changes or modifications made to this equipment not expressly approved by Endress+Hauser may void the FCC authorization to operate this equipment.

Other standards and guidelines

- IEC/EN 61010-1
Safety Requirements for Electrical Equipment for Measurement, Control and Laboratory Use
- IEC/EN 55011
"EMC Emission, RF Emission for Class B". Industrial, scientific and medical equipment – Electromagnetic disturbance characteristics - Limits and methods of measurement
- IEC/EN 61000-4-2
EMC Immunity, ESD (Performance Criteria A). Electromagnetic compatibility (EMC): Testing and measurement techniques - Electrostatic discharge immunity test (ESD)
- IEC/EN 61000-4-3
EMC Immunity, RF field susceptibility (Performance Criteria A). Electromagnetic compatibility (EMC): Testing and measurement techniques - Radiated, radio-frequency, electromagnetic field immunity test
- IEC/EN 61000-4-4
EMC Immunity, bursts (Performance Criteria B). Electromagnetic compatibility (EMC): Testing and measurement techniques - Electrical fast transient/burst immunity test
- IEC/EN 61000-4-5
EMC Immunity, surge (Performance Criteria B). Electromagnetic compatibility (EMC): Testing and measurement techniques - Surge immunity test
- IEC/EN 61000-4-6
EMC Immunity, conducted HF (Performance Criteria A). Electromagnetic compatibility (EMC): Testing and measurement techniques - Immunity to conducted disturbances induced by radio-frequency fields
- IEC/EN 61000-4-8
EMC Immunity, magnetic fields 50 Hz. Electromagnetic compatibility (EMC): Testing and measurement techniques - Power frequency magnetic field immunity test
- EN 61000-6-3
EMC Emission, conducted HF. EMC: Radiated interference - Residential, commercial and light industry environment
- NAMUR NE 21
Electromagnetic compatibility (EMC) of industrial process and laboratory control equipment
- NAMUR NE 43
Standardization of the signal level for the breakdown information of digital transmitters with analog output signal.
- NAMUR NE 107
Status classification as per NE107
- NAMUR NE 131
Requirements for field devices for standard applications.
- IEEE 802.15.1
Requirements for *Bluetooth*[®] wireless technology interface

Ordering information

Detailed ordering information is available from the following sources:

- In the Product Configurator on the Endress+Hauser website: www.endress.com -> Click "Corporate" -> Select your country -> Click "Products" -> Select the product using the filters and search field -> Open product page -> The "Configure" button to the right of the product image opens the Product Configurator.
- From your Endress+Hauser Sales Center: www.addresses.endress.com




Product Configurator - the tool for individual product configuration

- Up-to-the-minute configuration data
- Depending on the device: Direct input of measuring point-specific information such as measuring range or operating language
- Automatic verification of exclusion criteria
- Automatic creation of the order code and its breakdown in PDF or Excel output format
- Ability to order directly in the Endress+Hauser Online Shop

Accessories

Device-specific accessories

Weather protection cover

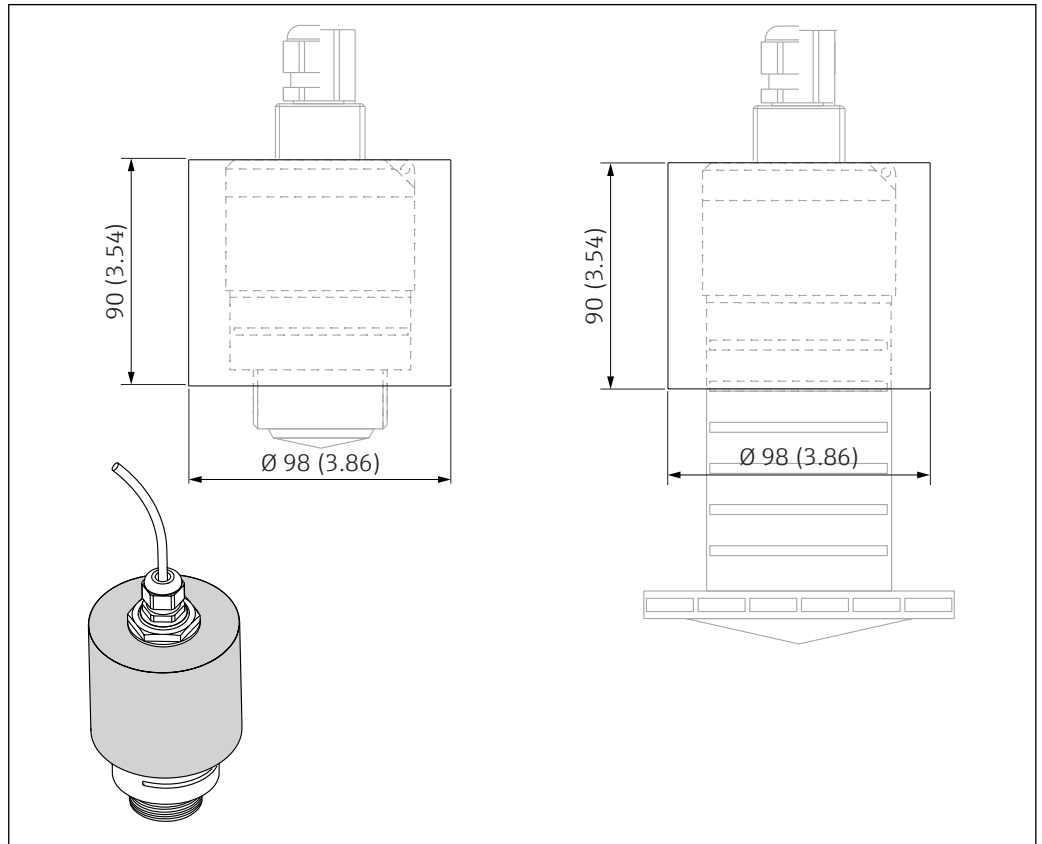

A0028841

32 Dimensions of weather protection cover, engineering unit: mm (in)


Material: PVDF

i The weather protection cover can be ordered with the device (product structure, feature 620 "Accessory enclosed", option R1 "weather protection cover").

Alternatively it can be ordered separately as an accessory; order number 52025686.

The sensor is not completely covered in the case of the 40 mm (1.5 in) antenna or the 80 mm (3 in) antenna.

Securing nut G1-1/2

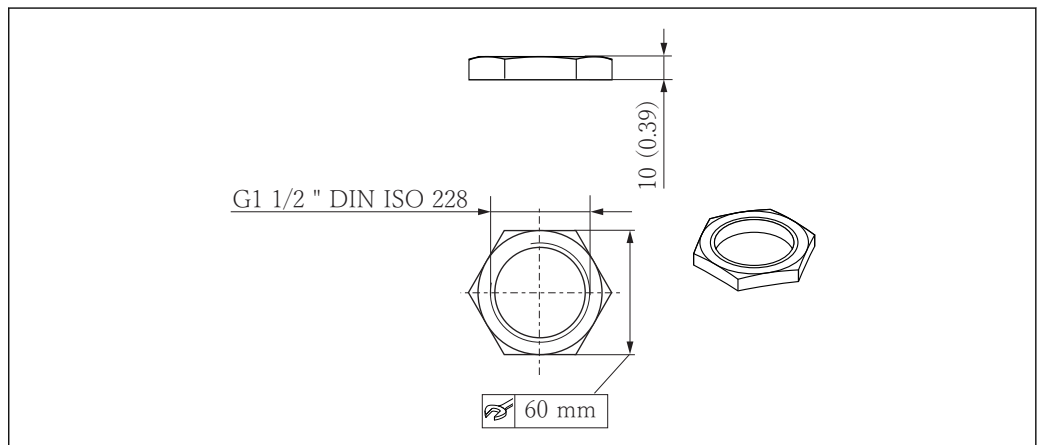

A0028849


33 Dimensions of securing nut, engineering unit: mm (in)

Suitable for use with devices with G 1-1/2 and MNPT 1-1/2 process connection.

Material: PC

Order number: 52014146

Securing nut G2

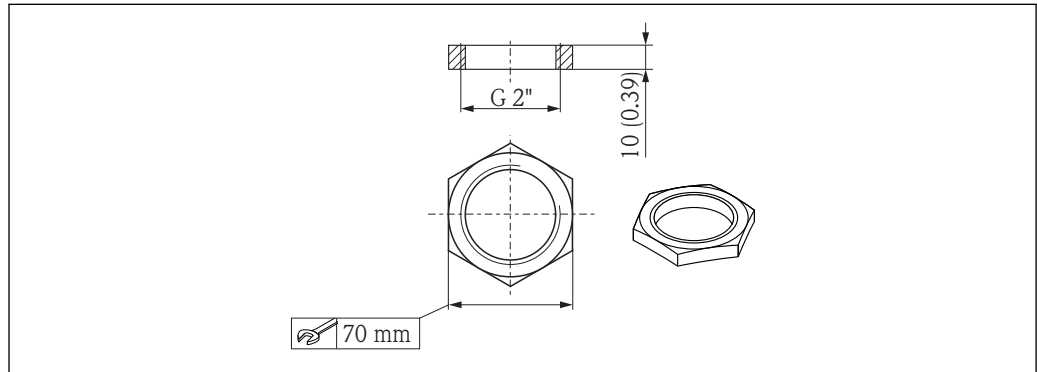


34 Dimensions of securing nut, engineering unit: mm (in)

Suitable for use with devices with G 2 and MNPT 2 process connection at front.

Material: PC

Order number: 52000598

Flooding protection tube 40 mm (1.5 in) antenna, metallized PBT-PC

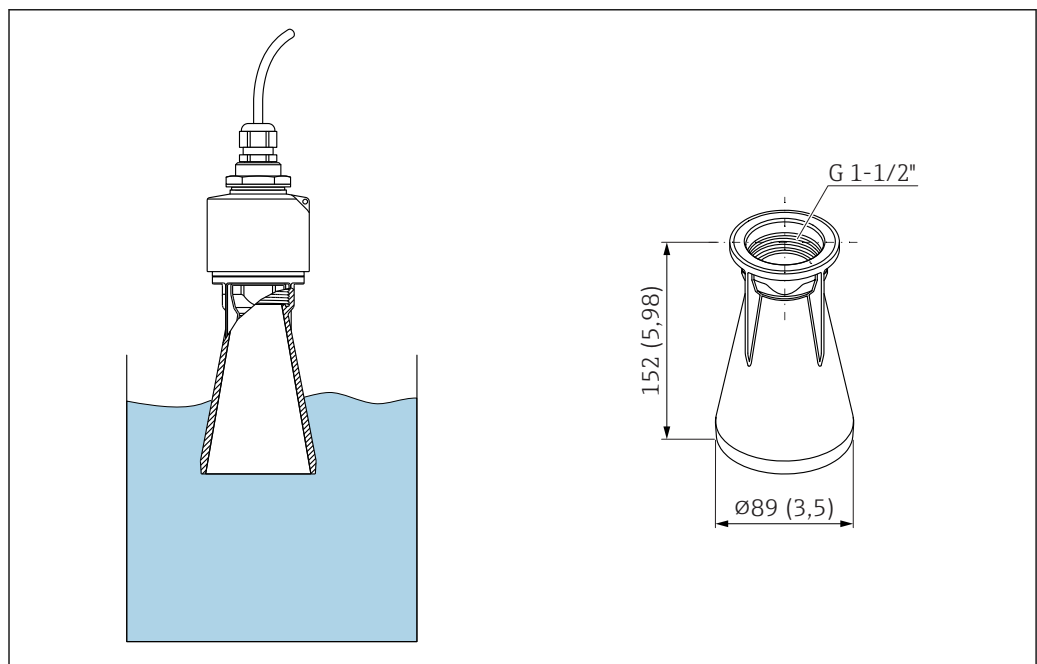


For use with devices in product structure, feature 100 "Process connection front", option WFE "Thread ISO228 G1-1/2".

Material: PBT-PC, metallized

i The flooding protection tube can be ordered with the device. Product structure, feature 620 "Accessory enclosed", option R7 "Flooding protection tube, metallized PBT-PC suitable for 40 mm (1.5 in) antenna with process connection on front G1-1/2".

Alternatively available as an accessory; order number 71325090.

Flooding protection tube 80 mm (3 in) antenna, metallized PBT-PC

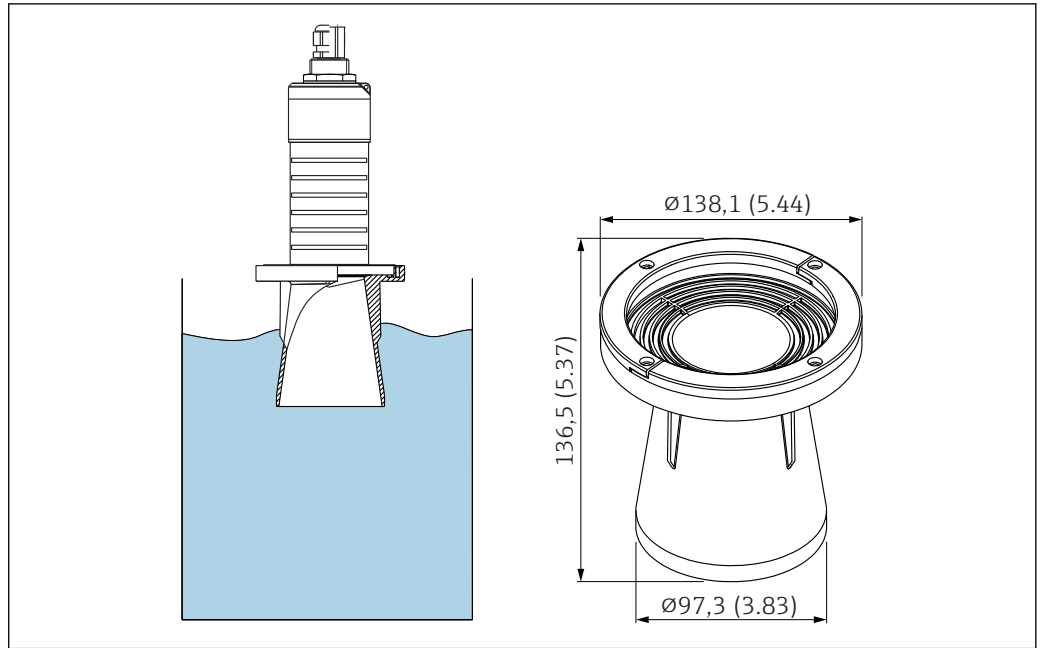

A0031094


For use with devices in product structure, feature 100 "Process connection front", option XRO "Mounting customer side w/o flange".

Material: PBT-PC, metallized

i The flooding protection tube can be ordered with the device. Product structure, feature 620 "Accessory enclosed", option R8 "Flooding protection tube, metallized PBT-PC suitable for 80 mm (3 in) antenna.

Alternatively available as an accessory; order number 71327051.

Mounting bracket, adjustable

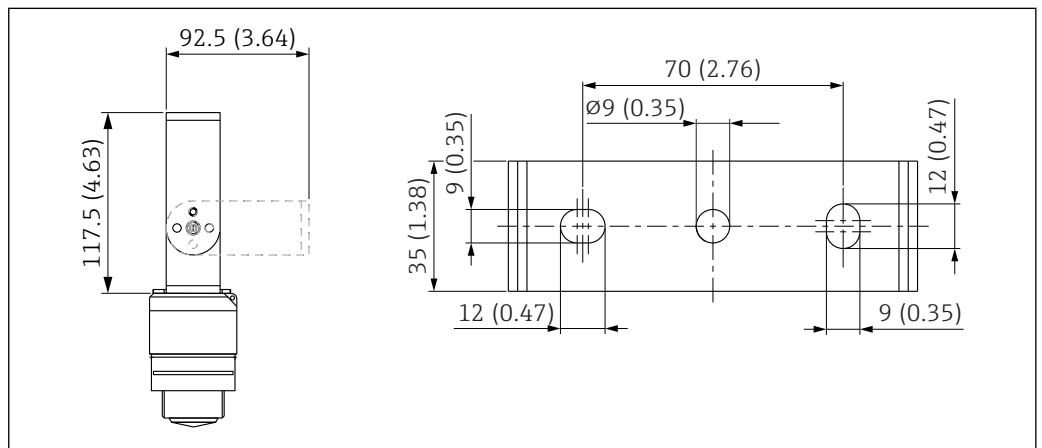

A0028861

35 Dimensions of mounting bracket, engineering unit: mm (in)

- A Ceiling installation
- B Wall mounting


Consists of:

- Mounting bracket: 316 (1.4404)
- Angle bracket: 316L (1.4404)
- Screws: A4
- Retaining rings: A4

i The mounting bracket can be ordered with the device (product structure, feature 620 "Accessory enclosed", option R3 "Mounting bracket adjustable, 316L").

Alternatively, it is available as an accessory, order number 71325079.

UNI flange

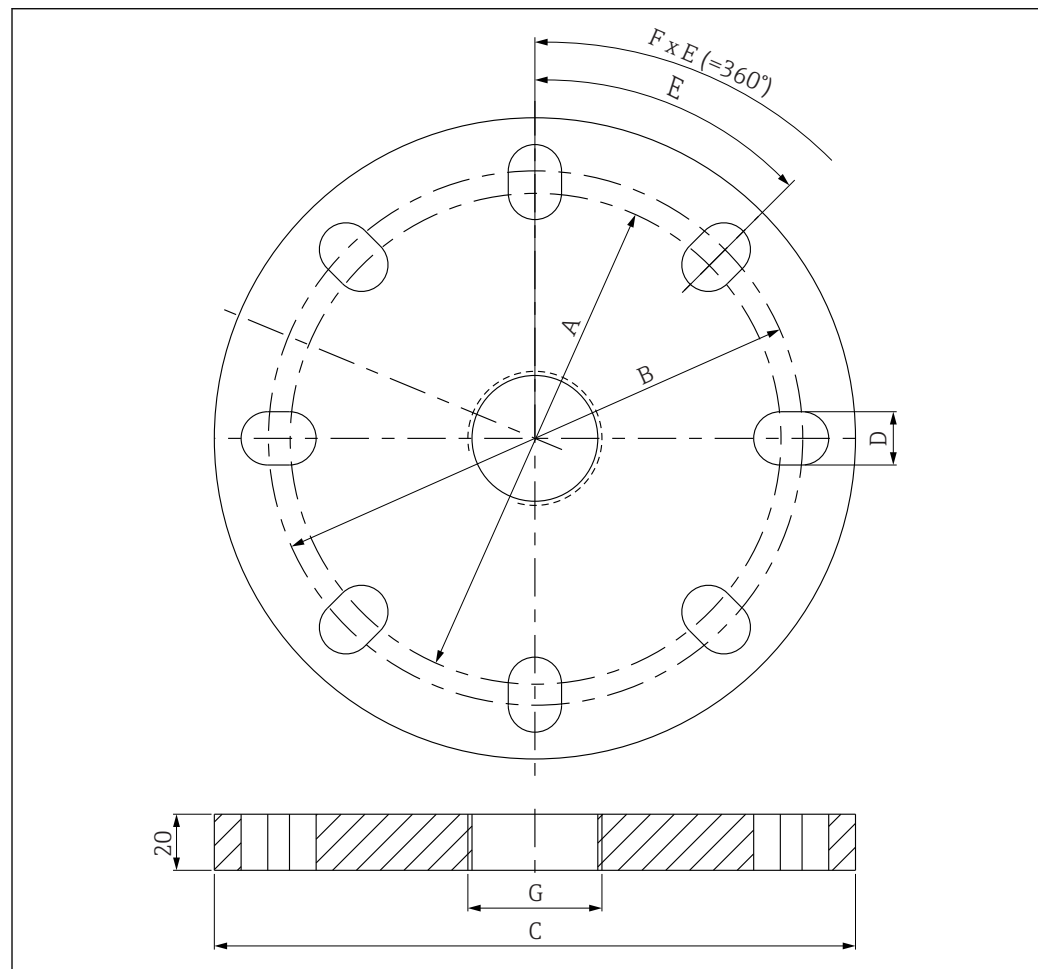


A0031103

36 Dimensions of UNI flange, engineering unit: mm

| Product structure Feature 620 "Accessory enclosed" Option: | A (mm) | B (mm) | C (mm) | D (mm) | E | F Number of drills | G Product structure Feature 95 "Process connection front side" Option: | G Product structure Feature 100 "Process connection rear side" Option: | Order Code Accessory |
|---|--------|--------|--------|--------|-----|-----------------------|--|--|-------------------------|
| RA UNI flange 2"/DN50/50, PP, front side | 120 | 125 | 165 | 19 | 90° | 4 | VEE Thread ASME MNPT1-1/2 | | FAX50-XIGG |
| RA UNI flange 2"/DN50/50, PP, front side | 120 | 125 | 165 | 19 | 90° | 4 | WFE Thread ISO228 G1-1/2 | | FAX50-XIGC |
| RA UNI flange 2"/DN50/50, PP, front side | 120 | 125 | 165 | 19 | 90° | 4 | VFE Thread ASME MNPT2 | | FAX50-XIGH |
| RA UNI flange 2"/DN50/50, PP, front side | 120 | 125 | 165 | 19 | 90° | 4 | WGE Thread ISO228 G2 | | FAX50-XIGD |
| RB *UNI flange 2"/DN50/50, PP, rear side | 120 | 125 | 165 | 19 | 90° | 4 | | VCE Thread ASME MNPT1 | FAX50-XIGF |
| RB *UNI flange 2"/DN50/50, PP, rear side | 120 | 125 | 165 | 19 | 90° | 4 | | WDE Thread G1 ISO228 | FAX50-XIGB |
| RD UNI flange 3"/DN80/80, PP, front side | 150 | 160 | 200 | 19 | 45° | 8 | VEE Thread ASME MNPT1-1/2 | | FAX50-XJGG |
| RD UNI flange 3"/DN80/80, PP, front side | 150 | 160 | 200 | 19 | 45° | 8 | WFE Thread ISO228 G1-1/2 | | FAX50-XJGC |
| RD UNI flange 3"/DN80/80, PP, front side | 150 | 160 | 200 | 19 | 45° | 8 | VFE Thread ASME MNPT2 | | FAX50-XJGH |
| RD UNI flange 3"/DN80/80, PP, front side | 150 | 160 | 200 | 19 | 45° | 8 | WGE Thread ISO228 G2 | | FAX50-XJGD |
| RE UNI flange 3"/DN80/80, PP, rear side | 150 | 160 | 200 | 19 | 45° | 8 | | VCE Thread ASME MNPT1 | FAX50-XJGF |

| Product structure Feature 620 "Accessory enclosed" Option: | A (mm) | B (mm) | C (mm) | D (mm) | E | F Number of drills | G Product structure Feature 95 "Process connection front side" Option: | G Product structure Feature 100 "Process connection rear side" Option: | Order Code Accessory |
|---|--------|--------|--------|--------|-----|-----------------------|--|--|-------------------------|
| RE UNI flange 3"/DN80/80, PP, rear side | 150 | 160 | 200 | 19 | 45° | 8 | | WDE Thread G1 ISO228 | FAX50-XJGB |
| RG UNI flange 4"/ DN100/100, PP, front side | 175 | 190.5 | 228.6 | 19 | 45° | 8 | VEE Thread ASME MNPT1-1/2 | | FAX50- XKGG |
| RG UNI flange 4"/ DN100/100, PP, front side | 175 | 190.5 | 228.6 | 19 | 45° | 8 | WFE Thread ISO228 G1-1/2 | | FAX50- XKGC |
| RG UNI flange 4"/ DN100/100, PP, front side | 175 | 190.5 | 228.6 | 19 | 45° | 8 | VFE Thread ASME MNPT2 | | FAX50- XKGH |
| RG UNI flange 4"/ DN100/100, PP, front side | 175 | 190.5 | 228.6 | 19 | 45° | 8 | WGE Thread ISO228 G2 | | FAX50- XKGD |
| RH UNI flange 4"/ DN100/100, PP, rear side | 175 | 190.5 | 228.6 | 19 | 45° | 8 | | VCE Thread ASME MNPT1 | FAX50- XKGF |
| RH UNI flange 4"/ DN100/100, PP, rear side | 175 | 190.5 | 228.6 | 19 | 45° | 8 | | WDE Thread G1 ISO228 | FAX50- XKGB |

Angle bracket for wall mount

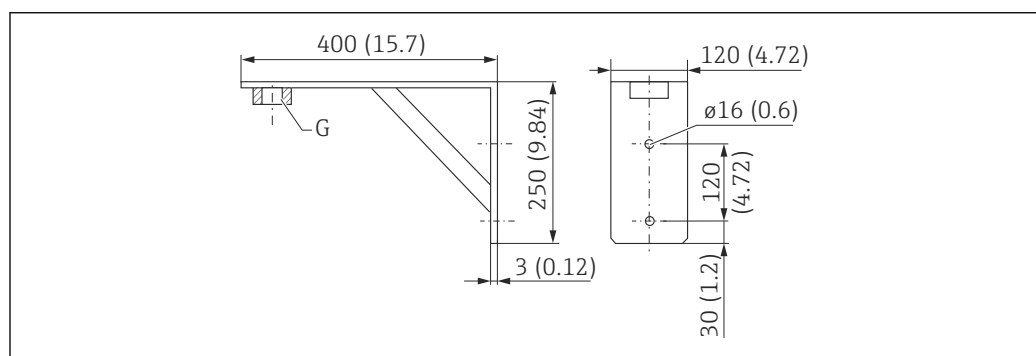


A0019346

37 Dimensions of angle bracket, engineering unit: mm (in)

| Process connection | Order No. | Material | Weight |
|---|-------------|-----------------|-----------------|
| G 1-1/2 | 942669-0000 | 316 Ti (1.4571) | 3.4 kg (7.5 lb) |
| G2 | 942669-0001 | | |
| also suitable for MNPT 1-1/2 and MNPT 2 | | | |

Cantilever with pivot

Installation type sensor process connection rear side

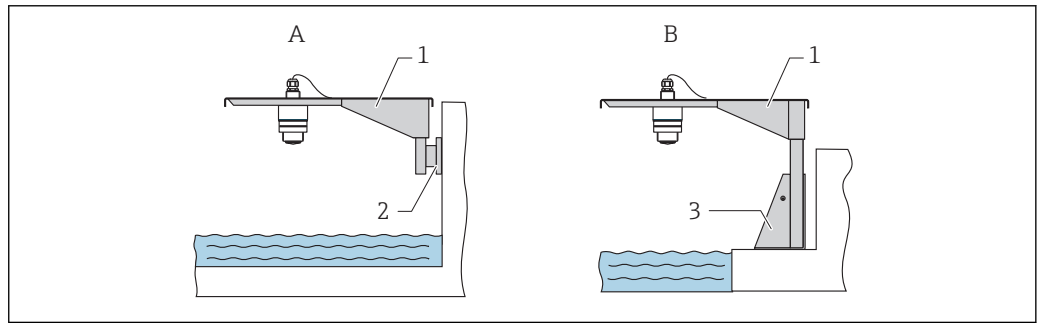


A0028885

38 Installation type sensor process connection rear side

- A Installation with cantilever and wall bracket
- B Installation with cantilever and mounting frame
- 1 Cantilever
- 2 Wall bracket
- 3 Mounting frame

Cantilever with pivot, sensor process connection on rear

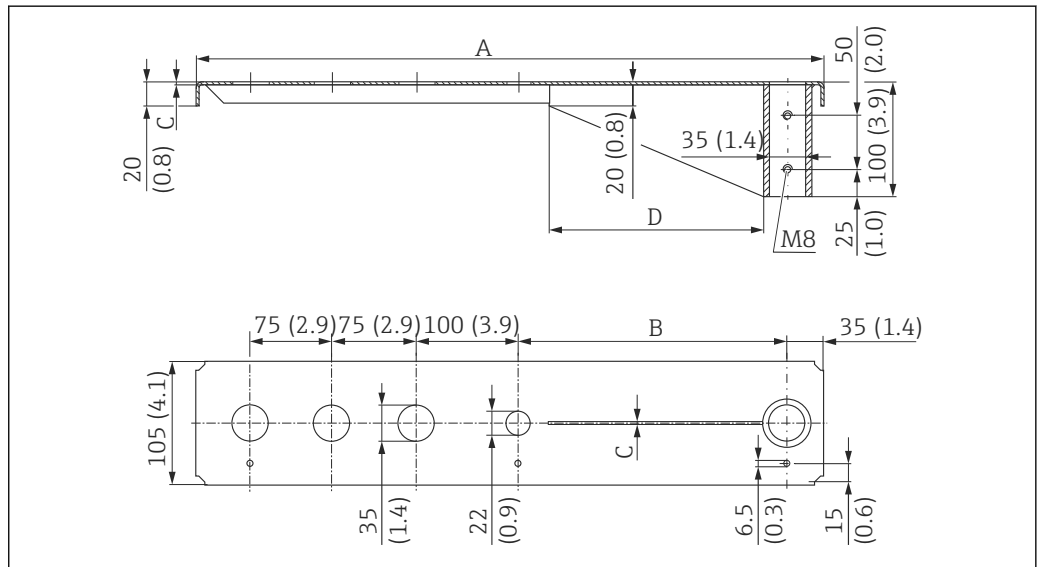

A0019592

39 Dimensions of cantilever with pivot for sensor process connection on rear, engineering unit: mm (in)


| A | B | C | D | Weight | Material | Order No. |
|-------------------|---------------------|-------------------|---------------------|---------------------|------------------------------|-------------|
| 585 mm (23 in) | 250 mm (9.84 in) | 2 mm (0.08 in) | 200 mm (7.87 in) | 2.1 kg (4.63 lb) | Steel, hot-dip galvanized | 919790-0000 |
| | | | | 2.0 kg (4.41 lb) | 316Ti (1.4571) | 919790-0001 |

| A | B | C | D | Weight | Material | Order No. |
|----------------------|---------------------|-------------------|---------------------|---------------------|------------------------------|-------------|
| 1085 mm (42.7 in) | 750 mm (29.5 in) | 3 mm (0.12 in) | 300 mm (11.8 in) | 4.5 kg (9.92 lb) | Steel, hot-dip galvanized | 919790-0002 |
| | | | | 4.3 kg (9.48 lb) | 316Ti (1.4571) | 919790-0003 |

- 35 mm (1.38 in) Openings for all G 1 or MNPT 1 connections on rear.
- 22 mm (0.87 in) Opening can be used for an additional sensor.

Retaining screws are included in delivery.

Installation type sensor process connection front side

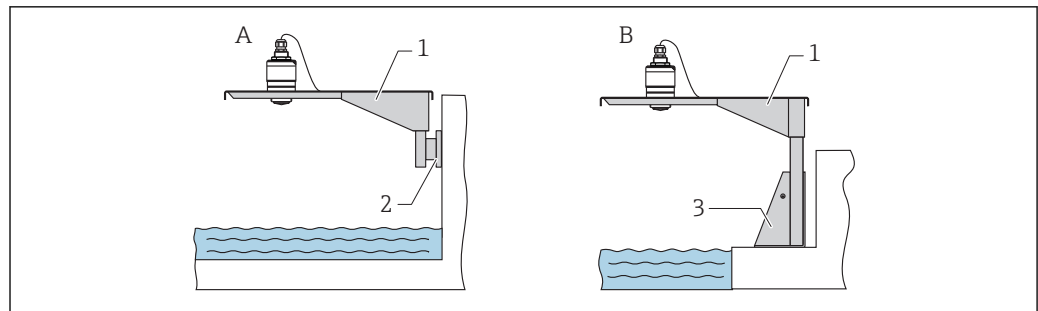


A0028886

40 Installation type sensor process connection front side

- A Installation with cantilever and wall bracket
- B Installation with cantilever and mounting frame
- 1 Cantilever
- 2 Wall bracket
- 3 Mounting frame

Cantilever with pivot, sensor process connection on front

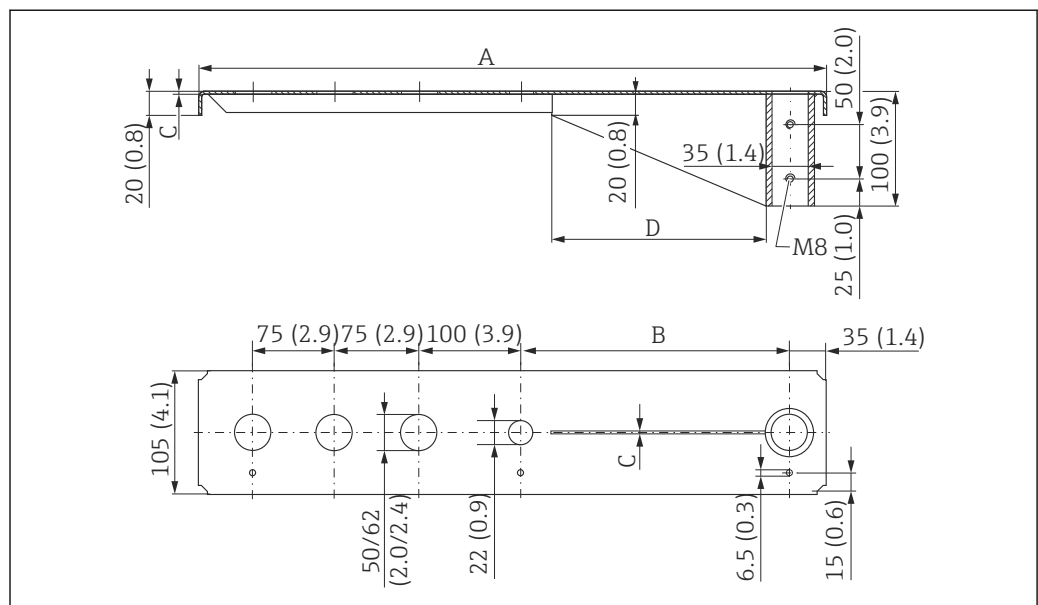

A0019349


41 Dimensions of cantilever with pivot for sensor process connection on front, engineering unit: mm (in)

| A | B | C | D | Weight | Sensor | Material | Order No. |
|----------------------|---------------------|-------------------|---------------------|---------------------|--------|------------------------------|-----------|
| 585 mm (23 in) | 250 mm (9.84 in) | 2 mm (0.08 in) | 200 mm (7.87 in) | 1.9 kg (4.19 lb) | 1-1/2 | Steel, hot-dip galvanized | 52014131 |
| | | | | | | 316Ti (1.4571) | 52014132 |
| | | | | | 2 | Steel, hot-dip galvanized | 52014135 |
| | | | | | | 316Ti (1.4571) | 52014136 |
| 1085 mm (42.7 in) | 750 mm (29.5 in) | 3 mm (0.12 in) | 300 mm (11.8 in) | 4.4 kg (9.7 lb) | 1-1/2 | Steel, hot-dip galvanized | 52014133 |
| | | | | | | 316Ti (1.4571) | 52014134 |
| | | | | | 2 | Steel, hot-dip galvanized | 52014137 |
| | | | | | | 316Ti (1.4571) | 52014138 |

- 50 mm (2.17 in) or 62 mm (2.44 in) openings for all connections on front G 1-1/2 (MNPT 1-1/2) or G 2 (MNPT 2).
- 22 mm (0.87 in) Opening can be used for an additional sensor.

Retaining screws are included in delivery.


Mounting stand for cantilever with pivot

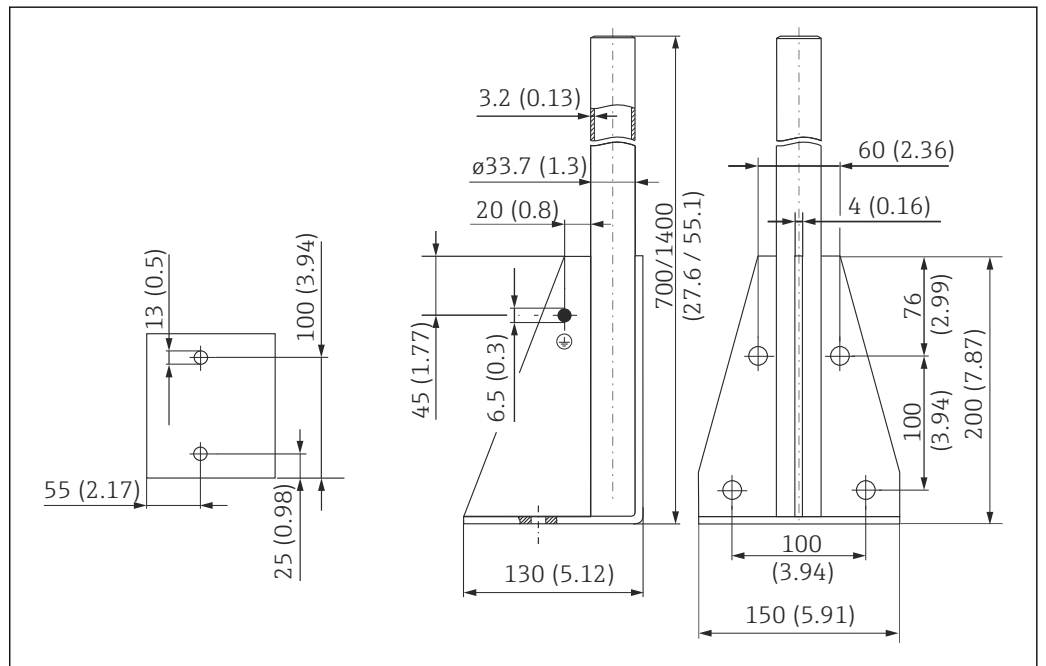

42 Dimensions of mounting frame, engineering unit: mm (in)

| Height | Material | Weight | Order No. |
|-------------------|-------------------|-------------------|-------------|
| 700 mm (27.6 in) | Steel, galvanized | 3.2 kg (7.06 lb) | 919791-0000 |
| 700 mm (27.6 in) | 316Ti (1.4571) | | 919791-0001 |
| 1400 mm (55.1 in) | Steel, galvanized | 4.9 kg (10.08 lb) | 919791-0002 |
| 1400 mm (55.1 in) | 316Ti (1.4571) | | 919791-0003 |

RIA15 in the field housing

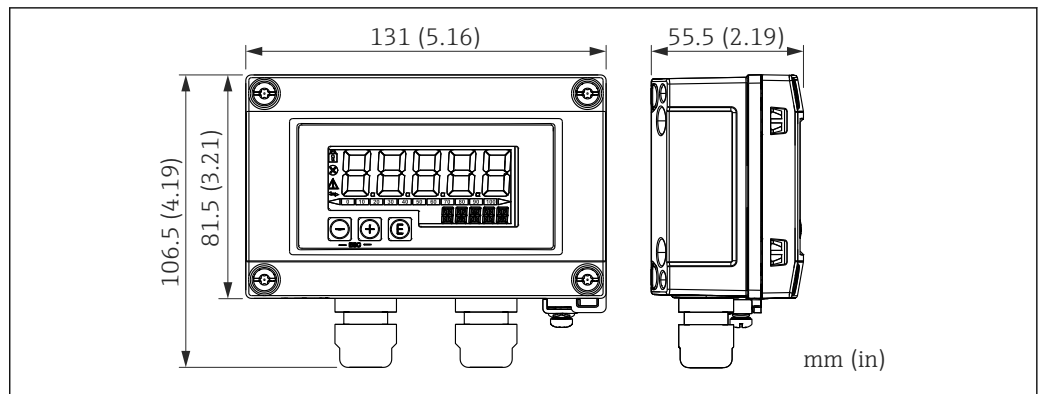

45 Dimensions of RIA15 in field housing, engineering unit: mm (in)


i The RIA15 remote display can be ordered together with the device. Product structure, feature 620 "Accessory enclosed":

- Option R4 "Remote display RIA15 non-hazardous area, field housing"
- Option R5 "Remote display RIA15 Ex= explosion protection approval, field housing"

i Alternatively it can be ordered separately as an accessory, for details: Technical Information TI01043K and Operating Instructions BA01170K

HART Kommunikationswiderstand

HART communication resistor

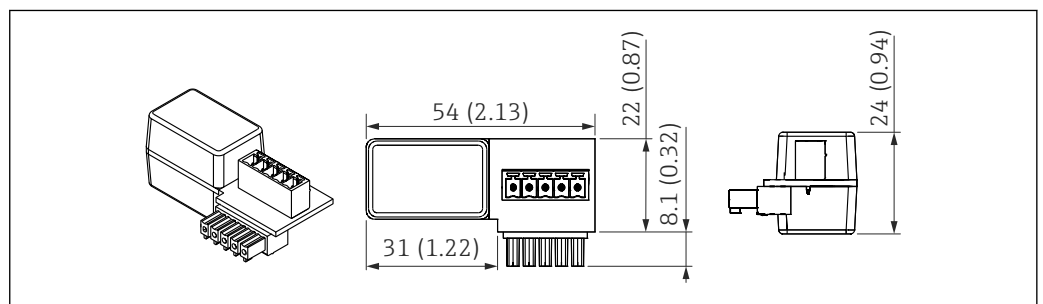


46 Dimensions of HART communication resistor, engineering unit: mm (in)

i A communication resistor is required for HART communication. If this is not already present (e.g. in the power supply RMA, RN221N, RNS221, ...), it can be ordered with the device via the product structure, feature 620 "Accessory enclosed": option R6 "HART communication resistor hazardous / non-hazardous area".


i Alternatively it can be ordered separately as an accessory, for details: Technical Information TI01043K and Operating Instructions BA01170K


The HART communication resistor is specially designed for use with the RIA15 and can be attached easily.

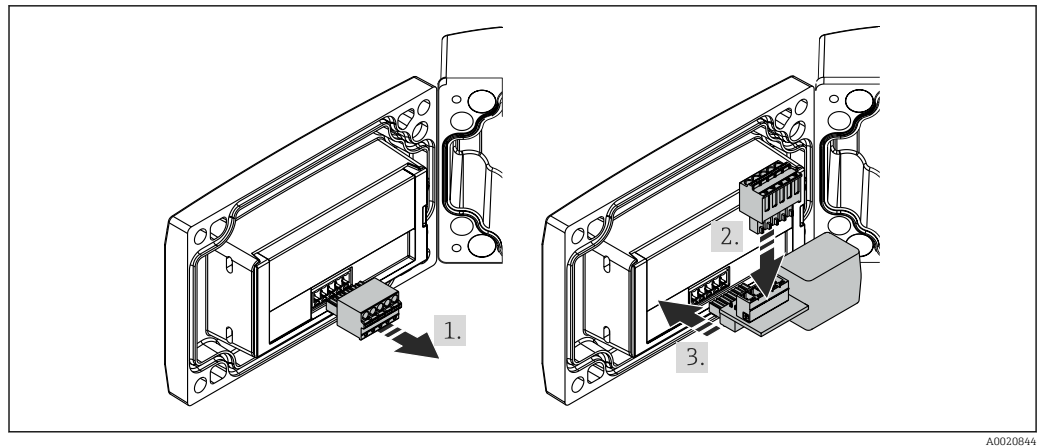



1. Disconnect plug-in terminal block.
2. Insert the terminal block into the slot provided on the HART communication resistor module.
3. Insert the HART communication resistor in the slot in the housing.


Communication-specific accessories


| Accessories | Description |
|----------------------|---|
| Commubox FXA195 HART | For intrinsically safe HART communication with FieldCare / DeviceCare via USB interface.  For details, see Technical Information TI00404F |


| Accessories | Description |
|---------------------------|--|
| HART Loop Converter HMX50 | Is used to evaluate and convert dynamic HART process variables to analog current signals or limit values. Order number: 71063562  For details, see Technical Information TI00429F and Operating Instructions BA00371F |

| Accessories | Description |
|----------------------------|--|
| WirelessHART adapter SWA70 | Is used for the wireless connection of field devices. The WirelessHART adapter can be easily integrated into field devices and existing infrastructures, offers data protection and transmission safety and can be operated in parallel with other wireless networks.  For details, see Operating Instructions BA00061S |


| Accessories | Description |
|------------------|---|
| Fieldgate FXA320 | Gateway for remote monitoring of field devices with 4 to 20 mA and digital output signal  For details, see Technical Information TI00025S and Operating Instructions BA00053S |

| Accessories | Description |
|-----------------------|--|
| Fieldgate FXA520 HART | Gateway for remote monitoring of field devices with HART / 4 to 20 mA and digital output signal  For details, see Technical Information TI00025S and Operating Instructions BA00051S |







| Accessories | Description |
|--------------------|---|
| Field Xpert SFX350 | Field Xpert SFX350 is a mobile computer for commissioning and maintenance. It enables efficient device configuration and diagnostics for HART and FOUNDATION Fieldbus devices in non-hazardous areas .  For details, see Operating Instructions BA01202S |

| Accessories | Description |
|--------------------|--|
| Field Xpert SFX370 | Field Xpert SFX370 is a mobile computer for commissioning and maintenance. It enables efficient device configuration and diagnostics for HART and FOUNDATION Fieldbus devices in non-hazardous areas and hazardous areas .  For details, see Operating Instructions BA01202S |

Service-specific accessories

| Accessory | Description |
|------------------------|--|
| FieldCare / DeviceCare | <p>Endress+Hauser's FDT-based Plant Asset Management tool. Helps to configure and maintain all field devices of your plant. By supplying status information it also supports the diagnosis of the devices.</p> <p> For details refer to Operating Instructions BA00027S and BA00059S.</p> |

System components

| Accessories | Description |
|--------------------------------------|--|
| Memograph M graphic display recorder | <p>The Memograph M graphic data manager provides information on all the relevant process variables. Measured values are recorded safely, limit values are monitored and measuring points analyzed. The data are stored in the 256 MB internal memory and also on an SD card or USB stick.</p> <p> For details, see Technical Information TI01180R and Operating Instructions BA01338R</p> |
| RNS221 | <p>Supply unit for powering two 2-wire measuring devices. Bidirectional communication is possible via the HART communication jacks.</p> <p> For details, see Technical Information TI00081R and Operating Instructions KA00110R</p> |
| RN221N | <p>Active barrier with power supply for safe separation of 4...20 mA current circuits Bi-directional HART-communication is possible using the built-in communication sockets (with resistance R=250 Ω)</p> <p> For details, see Technical Information TI073R and Operating Instructions BA202R</p> |
| RMA42 | <p>Digital process transmitter for monitoring and visualizing analog measured values</p> <p> For details, see Technical Information TI00150R and Operating Instructions BA00287R</p> |
| RIA452 | <p>Digital process meter RIA452, in panel mounted housing for monitoring and displaying analog measured values, batch, pump control functions and can be used as a preset counter and for measuring flow</p> <p> For details, see Technical Information TI113R and Operating Instructions BA00254R</p> |
| HAW562 | <p>Surge arrester for DIN rail according to IEC 60715, used to protect electronic components from being destroyed by overvoltage.</p> <p> For details, see Technical Information TI01012K</p> |

Supplementary documentation

The following document types are available in the Download Area of the Endress+Hauser Internet site: www.endress.com → Download:

Standard documentation

| Device | Document type | Document code |
|--------|------------------------------|---------------|
| FMR20 | Brief Operating Instructions | KA01248F |

| Device | Document type | Document code |
|--------|------------------------|---------------|
| FMR20 | Operating Instructions | BA01578F |

Supplementary documentation

| Device | Document type | Document code |
|--------|------------------------|---------------|
| RIA15 | Technical Information | TI01043K |
| | Operating Instructions | BA01170K |

Safety Instructions (XA)

Depending on the approval, the following Safety Instructions (XA) are supplied with the device. They are an integral part of the Operating Instructions.

| Feature 020 "Power Supply; Output" | Approval | Available for |
|------------------------------------|--|-----------------------------------|
| | | A ¹⁾ , P ²⁾ |
| BA | ATEX: II 1 G Ex ia IIC T4 Ga | XA01443F |
| BB | ATEX: II 1/2 G Ex ia IIC T4 Ga/Gb | |
| IA | IEC: Ex ia IIC T4 Ga | |
| IB | IEC: Ex ia IIC T4 Ga/Gb | |
| CB | CSA C/US IS CL.I Div.1 Gr.A-D, AEx ia / Ex ia T4 | XA01445F |

- 1) 2-Draht; 4-20 mA HART
- 2) 2-Draht; 4-20 mA HART /Bluetooth®



The nameplate indicates the Safety Instructions (XA) that are relevant to the device.



www.addresses.endress.com
